



**US Army Corps
of Engineers®**

Levee Inspection Report

Name of System: Munster

Name of Segment: Munster

NLD System ID: 2605000006

NLD Segment ID: 2604000009

Segment Type: USACE Constructed, Public sponsor O&M

Levee Sponsor (Name and Organization): Little Calumet River Basin Development Commission

Inspection Report Prepared by: Yuki Galisanao

Date(s) of Inspection: 07/06/2020 - 07/06/2020

Other Segments Within This System

Segment Name	NLD Segment ID#	Segment Type	Segment Inspection Rating
NPS - Borman	2604000018	Non-Federally Constructed, local O&M	

Contents of Inspection Report:

☐ Levee Inspection Summary

Inspection Checklist

- ☒ General Items
- ☒ Levee Embankment
- ☒ Concrete Floodwalls
- ☒ Interior Drainage System
- ☒ Pump Stations
- ☐ FDR System Channels

☒ Public Sponsor Pre-Inspection Form

☐ National Flood Insurance Program (NFIP) - 44 CFR 65.10
Provision Evaluation

☒ General Instructions

☒ Maps

Type of Inspection: ☒ Routine Inspection ☐ Periodic Inspection ☐ Special Inspection

Purpose of Special Inspection: _____

Ratings:

Segment Rating: ☐ Acceptable ☒ Minimally Acceptable ☐ Unacceptable ☐ No Verdict

System Rating: ☐ Acceptable ☒ Minimally Acceptable ☐ Unacceptable ☐ No Verdict

LSPM Signature: _____

William A. Rockford

Date Approved: 4 Sept 2020

LSO Signature: _____

Date Approved: _____

Levee Inspection Team Members (Levee Sponsor, USACE, and Others)

Name	Organization	Discipline	Phone Number
Yuki Galisanao	USACE - Chicago District	Geotechnical	
Jeremy Harris	USACE - Chicago District	Structural	
Kathy Sitko	USACE - Chicago District	Structural	
Jonathan Lombardi	USACE - Chicago District	Mechanical	
Art Rundzaitis	USACE - Chicago District	Construction	
Margarita Ramirez-Rodriguez	USACE - Chicago District	Intern	
Weronika Zasadzki	USACE - Chicago District	Intern	
Luis Herrera	USACE - Chicago District	Intern	
Dan Repay	LCRBDC		
Multiple reps	Town of Munster		
Multiple reps	HSD		

Segment Rating Rationale:

[Describe the basis of the Segment rating considering (1) the general condition of the segment, (2) the rationale for Item ratings, categorized by Feature that contributed to the Segment rating, and (3) the number or severity of notable observations/deficiencies. The summary may also include information related to the condition of the levee, not otherwise captured in the Levee Inspection Checklist, if applicable.]

Minor issues with trees and tall vegetation, encroachments, rutting, animal burrows, possible tilting of the retaining wall, spalling and exposed rebar on the concrete cap, holes at the base of the concrete panels and at transitions, vegetation and silt at the outlets, debris in the sluice and flap gates, missing safety signs, minor structural issues at the pump stations, broken fencing, repairs for pumps and vents, corrosion, and megger testing.

System Rating Rationale:

[Synthesize information from the Segment rating rationales for each Segment within the System. For single-segment systems, see segment rating rationale above.]

Same as segment rating.

General Items for All Flood Damage Reduction Segments / Systems
For use during all inspections of all Flood Damage Reduction Segments / Systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
1. Operations and Maintenance Manuals	A	A	Levee Owner's Manual, O&M Manuals, and/or manufacturer's operating instructions are present.	Justification: Documents maintained by the Munster Public Works Department and relevant copies distributed to appropriate internal agencies.
		M	Sponsor manuals are lost or missing or out of date; however, sponsor will obtain manuals prior to next scheduled inspection.	
		U	Sponsor has not obtained lost or missing manuals identified during previous inspection.	
2. Emergency Supplies and Equipment (A or M only)	A	A	The sponsor maintains a stockpile of sandbags, shovels, and other flood fight supplies which will adequately supply all needs for the initial days of a flood fight. Sponsor determines required quantity of supplies after consulting with inspector.	2020-0089 : Supply material and empty sand bags. Around 126000 bags. (A) 2020-0092 : Filled sand bags and bags of sand. 14 boxed cases (10000 empty bags per box.) and roughly 20 pallets of filled sandbags. About 11 mega bags of sand (A) Justification: Town of Munster has ready inventory of flood fighting supplies and equipment (over 2000 filled sandbags, over 250k empty sandbags, 11 superbags (similar to Hesco), 2 pumps). Primary resources available through public works department at 508 Fisher St, but also can be supplemented by other city departments. Additional storage on Calumet Ave.
		M	The sponsor does not maintain an adequate supply of flood fighting materials as part of their preparedness activities.	
3. Flood Preparedness and Training (A or M only)	A	A	Sponsor has a written system-specific flood response plan and a solid understanding of how to operate, maintain, and staff the FDR system during a flood. Sponsor maintains a list of emergency contact information for appropriate personnel and other emergency response agencies.	Justification: System specific flood response plan is in place. Munster uses the RAVE emergency notification system to send messages to residents via phone, email, and web. Also has a notification system through the police department with reverse 911 and websites. Attends river committee monthly meetings. Road Closure performed at Northcote Bridge using blocks. Participated in a tabletop exercise in 2019. Updated Flood Handbooks were provided in 2019.
		M	The sponsor maintains a good working knowledge of flood response activities, but documentation of system-specific emergency procedures and emergency contact personnel is insufficient or out of date.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Levee Embankments

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
1. Unwanted Vegetation Growth ¹	M	A	The levee has little or no unwanted vegetation (trees, bush, or undesirable weeds), except for vegetation that is properly contained and/or situated on overbuilt sections, such that the mandatory 3-foot root-free zone is preserved around the levee profile. The levee has been recently mowed. The vegetation-free zone extends 15 feet from both the landside and riverside toes of the levee to the centerline of the tree. If the levee access easement doesn't extend to the described limits, then the vegetation-free zone must be maintained to the easement limits. Reference EM 1110-2-301 or Corps policy for regional vegetation variance.	2020-0045 : Vegetation close to riverside toe. (M) 2020-0300 : Trees on riverside toe. (M) 2020-0312 : Tall vegetation on riverside toe. (M) 2020-0315 : Tall vegetation on landside toe. (M) 2020-0321 : Trees and tall vegetation on landside toe and slope. (M) 2020-0327 : Bushes on landside toe. (M) 2020-0333 : Large trees on landside toe. (M) 2020-0342 : Tall vegetation on landside slope. (M) 2020-0384 : Tall vegetation on riverside toe. (M) 2020-0387 : Trees and tall vegetation on riverside toe. (M) 2020-0396 : Trees and tall vegetation on riverside toe. (M) 2020-0399 : Trees on riverside toe. (M) 2020-0405 : Trees on riverside toe. (M) 2020-0417 : Trees on riverside. (M) 2020-0420 : Trees on riverside toe. (M)
		M	Minimal vegetation growth (brush, weeds, or trees 2 inches in diameter or smaller) is present within the zones described above. This vegetation must be removed but does not currently threaten the operation or integrity of the levee.	
		U	Significant vegetation growth (brush, weeds, or any trees greater than 2 inches in diameter) is present within the zones described above and must be removed to reestablish or ascertain levee integrity.	
2. Sod Cover	A	A	There is good coverage of sod over the levee.	Justification: No issues noted.
		M	Approximately 25% of the sod cover is missing or damaged over a significant portion or over significant portions of the levee embankment. This may be the result of over-grazing or feeding on the levee, unauthorized vehicular traffic, chemical or insect problems, or burning during inappropriate seasons.	
		U	Over 50% of the sod cover is missing or damaged over a significant portion or portions of the levee embankment.	
		N/A	Surface protection is provided by other means.	
3. Encroachments	M	A	No trash, debris, unauthorized farming activity, structures, excavations, or other obstructions present within the easement area. Encroachments have been previously reviewed by the Corps, and it was determined that they do not diminish proper functioning of the levee.	2020-0033 : Large log on riverside toe. (M) 2020-0309 : Downed tree on landside toe and slope. (M) 2020-0324 : Garden on landside slope. (M) 2020-0330 : Fence on landside toe. (M) 2020-0336 : Small fence on landside toe. (M) 2020-0339 : Fence on landside toe. (M) 2020-0423 : Sign on levee crest. (M)
		M	Trash, debris, unauthorized farming activity, structures, excavations, or other obstructions present, or inappropriate activities noted that should be corrected but will not inhibit operations and maintenance or emergency operations. Encroachments have not been reviewed by the Corps.	
		U	Unauthorized encroachments or inappropriate activities noted are likely to inhibit operations and maintenance, emergency operations, or negatively impact the integrity of the levee.	
4. Closure Structures	A	A	Closure structure in good repair. Placing equipment, stoplogs, and other materials are readily available at all times. Components are clearly marked and installation instructions/ procedures readily available. Trial erections have been accomplished in accordance with the O&M Manual.	Justification: No issues note.
		U	Any of the following issues is cause for this rating: Closure structure in poor condition. Parts missing or corroded. Placing equipment may not be available within the anticipated warning time. The storage vaults cannot be opened during the time of inspection. Components of closure are not clearly marked and installation instructions/ procedures are not readily available. Trial erections have not been accomplished in accordance with the O&M Manual.	
		N/A	There are no closure structures along this component of the FDR segment / system.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Levee Embankments

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
5. Slope Stability	A	A	No slides, sloughs, tension cracking, slope depressions, or bulges are present.	Justification: No issues noted.
		M	Minor slope stability problems that do not pose an immediate threat to the levee embankment.	
		U	Major slope stability problems (ex. deep seated sliding) identified that must be repaired to reestablish the integrity of the levee embankment.	
6. Erosion/ Bank Caving	A	A	No erosion or bank caving is observed on the landward or riverward sides of the levee that might endanger its stability.	Justification: No issues noted.
		M	There are areas where minor erosion is occurring or has occurred on or near the levee embankment, but levee integrity is not threatened.	
		U	Erosion or caving is occurring or has occurred that threatens the stability and integrity of the levee. The erosion or caving has progressed into the levee section or into the extended footprint of the levee foundation and has compromised the levee foundation stability.	
7. Settlement ²	A	A	No observed depressions in crown. Records exist and indicate no unexplained historical changes.	Justification: No issues noted.
		M	Minor irregularities that do not threaten integrity of levee. Records are incomplete or inclusive.	
		U	Obvious variations in elevation over significant reaches. No records exist or records indicate that design elevation is compromised.	
8. Depressions/ Rutting	M	A	There are scattered, shallow ruts, pot holes, or other depressions on the levee that are unrelated to levee settlement. The levee crown, embankments, and access road crowns are well established and drain properly without any ponded water.	2020-0042 : Rutting on riverside slope. (M) 2020-0318 : Rutting on landside slope. (M) 2020-0390 : Rutting on landside toe. (M) 2020-0393 : Rutting near landside toe. (M)
		M	There are some infrequent minor depressions less than 6 inches deep in the levee crown, embankment, or access roads that will pond water.	
		U	There are depressions greater than 6 inches deep that will pond water.	
9. Cracking	A	A	Minor longitudinal, transverse, or desiccation cracks with no vertical movement along the crack. No cracks extend continuously through the levee crest.	Justification: No issues noted.
		M	Longitudinal and/or transverse cracks up to 6 inches in depth with no vertical movement along the crack. No cracks extend continuously through the levee crest. Longitudinal cracks are no longer than the height of the levee.	
		U	Cracks exceed 6 inches in depth. Longitudinal cracks are longer than the height of the levee and/or exhibit vertical movement along the crack. Transverse cracks extend through the entire levee width.	
10. Animal Control	M	A	Continuous animal burrow control program in place that includes the elimination of active burrowing and the filling in of existing burrows.	2020-0036 : Tiny burrow in crest, one inch diameter, 3 inches deep. (M) 2020-0039 : Holes on riverside slope. (M)
		M	The existing animal burrow control program needs to be improved. Several burrows are present which may lead to seepage or slope stability problems, and they require immediate attention.	
		U	Animal burrow control program is not effective or is nonexistent. Significant maintenance is required to fill existing burrows, and the levee will not provide reliable flood protection until this maintenance is complete.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Levee Embankments

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
11. Culverts/ Discharge Pipes ³ (This item includes both concrete and corrugated metal pipes.)	A	A	There are no breaks, holes, cracks in the discharge pipes/ culverts that would result in significant water leakage. The pipe shape is still essentially circular. All joints appear to be closed and the soil tight. Corrugated metal pipes, if present, are in good condition with 100% of the original coating still in place (either asphalt or galvanizing) or have been relined with appropriate material, which is still in good condition. Condition of pipes has been verified using television camera video taping or visual inspection methods within the past five years, and the report for every pipe is available for review by the inspector.	Justification: Camera inspection performed in July and September 2016 for the following culverts: 36-inch RCP (MU-1), 48-inch RCP (MU-2A), 60-inch RCP (MU-2A,B), 54-inch RCP (MU-2B), 24-inch RCP (MU-3), 36-inch RCP (MU-4), 24-inch RCP (MU-5) - Circumferential cracks at joint, 36-inch RCP (MU-6), 36-inch RCP (MU-8), 54-inch RCP (MU-9), 96-inch RCP (MU-10A), 96-inch RCP (MU-10B). Monitor. Refer to the camera inspection report for more details. Next inspection should be performed in 2021.
		M	There are a small number of corrosion pinholes or cracks that could leak water and need to be repaired, but the entire length of pipe is still structurally sound and is not in danger of collapsing. Pipe shape may be ovalized in some locations but does not appear to be approaching a curvature reversal. A limited number of joints may have opened and soil loss may be beginning. Any open joints should be repaired prior to the next inspection. Corrugated metal pipes, if present, may be showing corrosion and pinholes but there are no areas with total section loss. Condition of pipes has been verified using television camera video taping or visual inspection methods within the past five years, and the report for every pipe is available for review by the inspector.	
		U	Culvert has deterioration and/or has significant leakage; it is in danger of collapsing or as already begun to collapse. Corrugated metal pipes have suffered 100% section loss in the invert. HOWEVER: Even if pipes appear to be in good condition, as judged by an external visual inspection, an Unacceptable Rating will be assigned if the condition of pipes has not been verified using television camera video taping or visual inspection methods within the past five years, and reports for all pipes are not available for review by the inspector.	
		N/A	There are no discharge pipes/ culverts.	
12. Riprap Revetments & Bank Protection	A	A	No riprap displacement or stone degradation that could pose an immediate threat to the integrity of channel bank. Riprap intact with no woody vegetation present.	Justification: No issues noted.
		M	Minor riprap displacement or stone degradation that could pose an immediate threat to the integrity of the channel bank. Unwanted vegetation must be cleared or sprayed with an appropriate herbicide.	
		U	Significant riprap displacement, exposure of bedding, or stone degradation observed. Scour activity is undercutting banks, eroding embankments, or impairing channel flows by causing turbulence or shoaling. Rock protection is hidden by dense brush, trees, or grasses.	
		N/A	There is no riprap protecting this feature of the segment / system, or riprap is discussed in another section.	
13. Revetments other than Riprap	A	A	Existing revetment protection is properly maintained, undamaged, and clearly visible.	2020-0402 : Slight tilting of retaining wall on landside. Monitor. (A)
		M	Minor revetment displacement or deterioration that does not pose an immediate threat to the integrity of the levee. Unwanted vegetation must be cleared or sprayed with an appropriate herbicide.	
		U	Significant revetment displacement, deterioration, or exposure of bedding observed. Scour activity is undercutting banks, eroding embankments, or impairing channel flows by causing turbulence or shoaling. Revetment protection is hidden by dense brush and trees.	
		N/A	There are no such revetments protecting this feature of the segment / system.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Levee Embankments

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
14. Underseepage Relief Wells/ Toe Drainage Systems	NA	A	Toe drainage systems and pressure relief wells necessary for maintaining FDR segment / system stability during high water functioned properly during the last flood event and no sediment is observed in horizontal system (if applicable). Nothing is observed which would indicate that the drainage systems won't function properly during the next flood, and maintenance records indicate regular cleaning. Wells have been pumped tested within the past 5 years and documentation is provided.	
		M	Toe drainage systems or pressure relief wells are damaged and may become clogged if they are not repaired. Maintenance records are incomplete or indicate irregular cleaning and pump testing.	
		U	Toe drainage systems or pressure relief wells necessary for maintaining FDR segment / system stability during flood events have fallen into disrepair or have become clogged. No maintenance records. No documentation of the required pump testing.	
		N/A	There are no relief wells/ toe drainage systems along this component of the FDR segment / system.	
15. Seepage	A	A	No evidence or history of unrepaired seepage, saturated areas, or boils.	Justification: No issues noted.
		M	Evidence or history of minor unrepaired seepage or small saturated areas at or beyond the landside toe but not on the landward slope of levee. No evidence of soil transport.	
		U	Evidence or history of active seepage, extensive saturated areas, or boils.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

For Official Use Only (FOUO): This document contains levee information that shall not be released in an uncontrolled manner

**Flood Damage Reduction Segments / Systems
Inspection Report**

**Levee Embankments
Page 4 of 4**

Floodwalls

For use during Initial and Continuing Eligibility Inspections of all floodwalls

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
1. Unwanted Vegetation Growth ¹	M	A	A grass-only or paved zone is maintained on both sides of the floodwall, free of all trees, brush, and undesirable weeds. The vegetation-free zone extends 15 feet from both the land and riverside of the floodwall, at ground-level, to the centerline of the tree. Additionally, an 8- foot root-free zone is maintained around the entire structure, including the floodwall toe, heel, and any toe-drains. If the floodwall access easement doesn't extend to the described limits, then the vegetation-free zone must be maintained to the easement limits. Reference EM 1110- 2-301 and/or Corps policy for regional vegetation variance.	2020-0012 : Trees on riverside. (M) 2020-0030 : Vegetation on riverside. (M) 2020-0063 : Trees on riverside. (M) 2020-0072 : Tall vegetation and trees close to riverside of wall. (M) 2020-0096 : Two small trees close to wall. (M) 2020-0099 : Small tree near wall. (M)
		M	Minimal vegetation growth (brush, weeds, or trees 2 inches in diameter or smaller) is present within the zones described above. This vegetation must be removed but does not currently threaten the operation or integrity of the floodwall.	2020-0111 : Tree on riverside. (M) 2020-0171 : Large trees on riverside. (M) 2020-0234 : Trees on riverside. (M)
		U	Significant vegetation growth (brush, weeds, or any trees greater than 2 inches in diameter) is present within the zones described above. This vegetation threatens the operation or integrity of the floodwall and must be removed.	2020-0297 : Vegetation on landside. (M) 2020-0345 : Small trees close to wall. (M)
2. Encroachments	M	A	No trash, debris, unauthorized structures, excavations, or other obstructions present within the easement area. Encroachments have been previously reviewed by the Corps, and it was determined that they do not diminish proper functioning of the floodwall.	2020-0114 : Downed tree in riprap on riverside. (M) 2020-0117 : Grass clippings on riverside. (M) 2020-0210 : Downed tree on wall. (M)
		M	Trash, debris, unauthorized structures, excavations, or other obstructions present, or inappropriate activities noted that should be corrected but will not inhibit operations and maintenance or emergency operations. Encroachments have not been reviewed by the Corps.	2020-0228 : Debris next to wall on riverside. (M) 2020-0264 : Debris on landside. (M)
		U	Unauthorized encroachments or inappropriate activities noted are likely to inhibit operations and maintenance, emergency operations, or negatively impact the integrity of the floodwall.	2020-0303 : Debris on landside. (M)
3. Closure Structures (Stop Log Closures and Gates) (A or U only)	A	A	Closure structure in good repair. Placing equipment, stoplogs, and other materials are readily available at all times. Components are clearly marked and installation instructions/ procedures readily available. Trial erections have been accomplished in accordance with the O&M Manual.	Justification: No issues noted.
		U	Any of the following issues is cause for this rating: Closure structure in poor condition. Parts missing or corroded. Placing equipment may not be available within the anticipated warning time. The storage vaults cannot be opened during the time of inspection. Components of closure are not clearly marked and installation instructions/ procedures are not readily available. Trial erections have not been accomplished in accordance with the O&M Manual.	
		N/A	There are no closure structures along this component of the FDR segment / system.	
4. Concrete Surfaces	M	A	Negligible spalling, scaling or cracking. If the concrete surface is weathered or holds moisture, it is still satisfactory but should be seal coated to prevent freeze/ thaw damage.	2020-0018 : Spalling on cap. (M) 2020-0021 : Spalling, exposed waterstop. (M) 2020-0027 : Exposed rebar on landside. (M)
		M	Spalling, scaling, and open cracking present, but the immediate integrity or performance of the structure is not threatened. Reinforcing steel may be exposed. Repairs/ sealing is necessary to prevent additional damage during periods of thawing and freezing.	2020-0048 : Crack through levee. (M) 2020-0051 : Minor spalling on cap. (M) 2020-0054 : Crack on landside pillar. (M)
		U	Surface deterioration or deep cracks present that may result in an unreliable structure. Any surface deterioration that exposes the sheet piling or lies adjacent to monolith joints may indicate underlying reinforcement corrosion and is unacceptable.	2020-0057 : Crack on landside. (M) 2020-0060 : Crack on landside. (M) 2020-0066 : Crack on wingwall on landside. (M) 2020-0105 : Spalling on cap. (M) 2020-0147 : Exposed rebar on cap. (M) 2020-0231 : Exposed rebar in cap. (M) 2020-0306 : Broken cap at transition. (M)

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Floodwalls

For use during Initial and Continuing Eligibility Inspections of all floodwalls

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
5. Tilting, Sliding or Settlement of Concrete Structures ²	A	A	There are no significant areas of tilting, sliding, or settlement that would endanger the integrity of the structure.	Justification: No issues noted.
		M	There are areas of tilting, sliding, or settlement (either active or inactive) that need to be repaired. The maximum offset, either laterally or vertically, does not exceed 2 inches unless the movement can be shown to be no longer actively occurring. The integrity of the structure is not in danger.	
		U	There are areas of tilting, sliding, or settlement (either active or inactive) that threaten the structure's integrity and performance. Any movement that has resulted in failure of the waterstop (possibly identified by daylight visible through the joint) is unacceptable. Differential movement of greater than 2 inches between any two adjacent monoliths, either laterally or vertically, is unacceptable unless it can be shown that the movement is no longer active. Also, if the floodwall is of I-wall construction, then any visible or measurable tilting of the wall toward the protected side that has created an open horizontal crack on the riverside base of a monolith is unacceptable.	
6. Foundation of Concrete Structures ¹	M	A	No active erosion, scouring, or bank caving that might endanger the structure's stability.	2020-0243 : Holes on landside. (M) 2020-0282 : 3.5 ft burrow leading to wall on landside. (M) 2020-0291 : Holes on landside. (M) 2020-0351 : Holes on landside. (M) 2020-0357 : Hole at wall transition. (M) 2020-0360 : Hole at wall transition. (M) 2020-0369 : Holes on landside. (M) 2020-0372 : Hole at wall transition. (M) 2020-0375 : Hole at wall transition. (M) 2020-0378 : Holes on landside. (M)
		M	There are areas where the ground is eroding towards the base of the structure. Efforts need to be taken to slow and repair this erosion, but it is not judged to be close enough to the structure or to be progressing rapidly enough to affect structural stability before the next inspection. For the purposes of inspection, the erosion or scour is not closer to the riverside face of the wall than twice the floodwall's underground base width if the wall is of L-wall or T-wall construction; or if the wall is of sheetpile or I-wall construction, the erosion is not closer than twice the wall's visible height. Additionally, rate of erosion is such that the wall is expected to remain stable until the next inspection.	
		U	Erosion or bank caving observed that is closer to the wall than the limits described above, or is outside these limits but may lead to structural instabilities before the next inspection. Additionally, if the floodwall is of I-wall or sheetpile construction, the foundation is unacceptable if any turf, soil or pavement material got washed away from the landside of the I-wall as the result of a previous overtopping event.	
7. Monolith Joints	M	A	The joint material is in good condition. The exterior joint sealant is intact and cracking/ desiccation is minimal. Joint filler material and/or waterstop is not visible at any point.	2020-0015 : Deteriorating sealant on landside. (M) 2020-0084 : Deteriorating sealant on landside. (M) 2020-0093 : Filler material exposed in cap. (M) 2020-0126 : Deteriorating sealant at bottom on landside. (M) 2020-0144 : Deteriorating sealant on landside. (M) 2020-0195 : Deteriorating joints. (M)
		M	The joint material has appreciable deterioration to the point where joint filler material and/or waterstop is visible in some locations. This needs to be repaired or replaced to prevent spalling and cracking during freeze/ thaw cycles, and to ensure water tightness of the joint.	
		U	The joint material is severely deteriorated or the concrete adjacent to the monolith joints has spalled and cracked, damaging the waterstop; in either case damage has occurred to the point where it is apparent that the joint is no longer watertight and will not provide the intended level of protection during a flood.	
		N/A	There are no monolith joints in the floodwall.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Floodwalls

For use during Initial and Continuing Eligibility Inspections of all floodwalls

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
8. Underseepage Relief Wells/ Toe Drainage Systems	NA	A	Toe drainage systems and pressure relief wells necessary for maintaining FDR segment / system stability during high water functioned properly during the last flood event and no sediment is observed in horizontal system (if applicable). Nothing is observed which would indicate that the drainage systems won't function properly during the next flood, and maintenance records indicate regular cleaning. Wells have been pumped tested within the past 5 years and documentation is provided.	
		M	Toe drainage systems or pressure relief wells are damaged and may become clogged if they are not repaired. Maintenance records are incomplete or indicate irregular cleaning and pump testing.	
		U	Toe drainage systems or pressure relief wells necessary for maintaining FDR segment / system stability during flood events have fallen into disrepair or have become clogged. No maintenance records. No documentation of the required pump testing.	
		N/A	There are no relief wells/ toe drainage systems along this component of the FDR segment / system.	
9. Seepage	A	A	No evidence or history of unrepaired seepage, saturated areas, or boils.	Justification: No issues noted. Seepage repair east of Calumet Ave was completed in 2020.
		M	Evidence or history of minor unrepaired seepage or small saturated areas at or beyond the landside toe but not on the landward slope of levee. No evidence of soil transport.	
		U	Evidence or history of active seepage, extensive saturated areas, or boils.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Interior Drainage System

For use during Initial and Continuing Eligibility Inspections of interior drainage systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
1. Vegetation and Obstructions	M	A	No obstructions, vegetation, debris, or sediment accumulation noted within interior drainage channels or blocking the culverts, inlets, or discharge areas. Concrete joints and weep holes are free of grass and weeds.	2020-0020 : MU-9: Overgrown vegetation at outlet. (M) 2020-0044 : MU-5: Vegetation at gateway. (M) 2020-0068 : MU-3: Heavy vegetation at outlet. (M) 2020-0408 : MU-3: Outlet blocked with silt. (M) 2020-0411 : MU-3: Small trees around gateway. (M) 2020-0414 : MU-3: Vegetation around inlet. (M) 2020-0426 : MU-12: Vegetation at outlet. (M)
		M	Obstructions, vegetation, debris, or sediment are minor and have not impaired channel flow capacity or blocked more than 10% of any culvert openings, but should be removed. A limited volume of grass and weeds may be present in concrete channel joints and weep holes.	
		U	Obstructions, vegetation, debris, or sediment have impaired the channel flow capacity or blocked more than 10% of a culvert opening. Sediment and debris removal required to reestablish flow capacity.	
2. Encroachments	A	A	No trash, debris, unauthorized structures, excavations, or other obstructions present within the easement area. Encroachments have been previously reviewed by the Corps, and it was determined that they do not diminish proper functioning of the interior drainage system.	Justification: No issues noted.
		M	Trash, debris, unauthorized structures, excavations, or other obstructions present, or inappropriate activities noted that should be corrected but will not inhibit operations and maintenance or emergency operations. Encroachments have not been reviewed by the Corps.	
		U	Unauthorized encroachments or inappropriate activities noted are likely to inhibit operations and maintenance, emergency operations, or negatively impact the integrity of this component of the interior drainage system.	
3. Ponding Areas	NA	A	No trash, debris, structures, or other obstructions present within the ponding areas. Sediment deposits do not exceed 10% of capacity.	
		M	Trash, debris, excavations, structures, or other obstructions present, or inappropriate activities that will not inhibit operations and maintenance. Sediment deposits do not exceed 30% of capacity.	
		U	Trash, debris, excavations, structures, or other obstructions, or other encroachments or activities noted that will inhibit operations, maintenance, or emergency work. Sediment deposits exceeds 30% of capacity.	
		N/A	There are no ponding areas associated with the interior drainage system.	
4. Fencing and Gates	A	A	Fencing is in good condition and provides protection against falling or unauthorized access. Gates open and close freely, locks are in place, and there is little corrosion on metal parts.	Justification: No issues noted.
		M	Fencing or gates are damaged or corroded but appear to be maintainable. Locks may be missing or damaged.	
		U	Fencing and gates are damaged or corroded to the point that replacement is required, or potentially dangerous features are not secured.	
		N/A	There are no features noted that require safety fencing.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Interior Drainage System

For use during Initial and Continuing Eligibility Inspections of interior drainage systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
5. Concrete Surfaces (Such as gatewells, outfalls, intakes, or culverts)	A	A	Negligible spalling, scaling or cracking. If the concrete surface is weathered or holds moisture, it is still satisfactory but should be seal coated to prevent freeze/ thaw damage.	Justification: No issues noted.
		M	Spalling, scaling, and open cracking present, but the immediate integrity or performance of the structure is not threatened. Reinforcing steel may be exposed. Repairs/ sealing is necessary to prevent additional damage during periods of thawing and freezing.	
		U	Surface deterioration or deep cracks present that may result in an unreliable structure. Any surface deterioration that exposes the sheet piling or lies adjacent to monolith joints may indicate underlying reinforcement corrosion and is unacceptable.	
		N/A	There are no concrete items in the interior drainage system.	
6. Tilting, Sliding or Settlement of Concrete and Sheet Pile Structures ² (Such as gate wells, outfalls, intakes, or culverts)	A	A	There are no significant areas of tilting, sliding, or settlement that would endanger the integrity of the structure.	Justification: No issues noted.
		M	There are areas of tilting, sliding, or settlement (either active or inactive) that need to be repaired. The maximum offset, either laterally or vertically, does not exceed 2 inches unless the movement can be shown to be no longer actively occurring. The integrity of the structure is not in danger.	
		U	There are areas of tilting, sliding, or settlement (either active or inactive) that threaten the structure's integrity and performance. Any movement that has resulted in failure of the waterstop (possibly identified by daylight visible through the joint) is unacceptable. Differential movement of greater than 2 inches between any two adjacent monoliths, either laterally or vertically, is unacceptable unless it can be shown that the movement is no longer active. Also, if the floodwall is of I-wall construction, then any visible or measurable tilting of the wall toward the protected side that has created an open horizontal crack on the riverside base of a monolith is unacceptable.	
		N/A	There are no concrete items in the interior drainage system.	
7. Foundation of Concrete Structures ³ (Such as culverts, inlet and discharge structures, or gatewells.)	A	A	No active erosion, scouring, or bank caving that might endanger the structure's stability.	Justification: No issues noted.
		M	There are areas where the ground is eroding towards the base of the structure. Efforts need to be taken to slow and repair this erosion, but it is not judged to be close enough to the structure or to be progressing rapidly enough to affect structural stability before the next inspection. The rate of erosion is such that the structure is expected to remain stable until the next inspection.	
		U	Erosion or bank caving observed that may lead to structural instabilities before the next inspection.	
		N/A	There are no concrete items in the interior drainage system.	
8. Monolith Joints	A	A	The joint material is in good condition. The exterior joint sealant is intact and cracking/ desiccation is minimal. Joint filler material and/or waterstop is not visible at any point.	Justification: No issues noted.
		M	The joint material has appreciable deterioration to the point where joint filler material and/or waterstop is visible in some locations. This needs to be repaired or replaced to prevent spalling and cracking during freeze/ thaw cycles, and to ensure water tightness of the joint.	
		U	The joint material is severely deteriorated or the concrete adjacent to the monolith joints has spalled and cracked, damaging the waterstop; in either case damage has occurred to the point where it is apparent that the joint is no longer watertight and will not provide the intended level of protection during a flood.	
		N/A	There are no monolith joints in the interior drainage system.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Interior Drainage System

For use during Initial and Continuing Eligibility Inspections of interior drainage systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
9. Culverts/ Discharge Pipes ⁴	A	A	There are no breaks, holes, cracks in the discharge pipes/ culverts that would result in significant water leakage. The pipe shape is still essentially circular. All joints appear to be closed and the soil tight. Corrugated metal pipes, if present, are in good condition with 100% of the original coating still in place (either asphalt or galvanizing) or have been relined with appropriate material, which is still in good condition. Condition of pipes has been verified using television camera video taping or visual inspection methods within the past five years, and the report for every pipe is available for review by the inspector.	Justification: Camera inspection performed in July and September 2016 for the following culverts: 36-inch RCP (MU-1), 48-inch RCP (MU-2A), 60-inch RCP (MU-2A,B), 54-inch RCP (MU-2B), 24-inch RCP (MU-3), 36-inch RCP (MU-4), 24-inch RCP (MU-5) - Circumferential cracks at joint, 36-inch RCP (MU-6), 36-inch RCP (MU-8), 54-inch RCP (MU-9), 96-inch RCP (MU-10A), 96-inch RCP (MU-10B). Monitor. Refer to the camera inspection report for more details. Next inspection should be performed in 2021.
		M	There are a small number of corrosion pinholes or cracks that could leak water and need to be repaired, but the entire length of pipe is still structurally sound and is not in danger of collapsing. Pipe shape may be ovalized in some locations but does not appear to be approaching a curvature reversal. A limited number of joints may have opened and soil loss may be beginning. Any open joints should be repaired prior to the next inspection. Corrugated metal pipes, if present, may be showing corrosion and pinholes but there are no areas with total section loss. Condition of pipes has been verified using television camera video taping or visual inspection methods within the past five years, and the report for every pipe is available for review by the inspector.	
		U	Culvert has deterioration and/or has significant leakage; it is in danger of collapsing or as already begun to collapse. Corrugated metal pipes have suffered 100% section loss in the invert. HOWEVER: Even if pipes appear to be in good condition, as judged by an external visual inspection, an Unacceptable Rating will be assigned if the condition of pipes has not been verified using television camera video taping or visual inspection methods within the past five years, and reports for all pipes are not available for review by the inspector.	
		N/A	There are no discharge pipes/ culverts.	
10. Sluice / Slide Gates ⁵	M	A	Gates open and close freely to a tight seal or minor leakage. Gate operators are in good working condition and are properly maintained. Sill is free of sediment and other obstructions. Gates and lifters have been maintained and are free of corrosion. Documentation provided during the inspection.	2020-0014 : MU-11: Gate not closed all the way. Sediment within gatewell. (M) 2020-0056 : MU-4: Sluice gate completely closed. Debris on sluice gate. (M) 2020-0074 : MU-2: Gate closed completely. Debris around sluice gate. (M) 2020-0086 : MU-1: Sluice gate closed completely but guide rail is bent. (M)
		M	Gates and/or operators have been damaged or have minor corrosion, and open and close with resistance or binding. Leakage quantity is controllable, but maintenance is required. Sill is free of sediment and other obstructions.	
		U	Gates do not open or close and/or operators do not function. Gate, stem, lifter and/or guides may be damaged or have major corrosion.	
		N/A	There are no sluice/ slide gates.	
11. Flap Gates/ Flap Valves/ Pinch Valves ¹	M	A	Gates/ valves open and close easily with minimal leakage, have no corrosion damage, and have been exercised and lubricated as required.	2020-0011 : MU-11: Water covering outlet structure. Unable to verify. (M) 2020-0065 : MU-3: Flap gate not closed fully. (M)
		M	Gates/ valves will not fully open or close because of obstructions that can be easily removed, or have minor corrosion damage that requires maintenance.	
		U	Gates/ valves are missing, have been damaged, or have deteriorated to the point that they need to be replaced.	
		N/A	There are no flap gates.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Interior Drainage System

For use during Initial and Continuing Eligibility Inspections of interior drainage systems

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
12. Trash Racks (non-mechanical)	A	A	Trash racks are fastened in place and properly maintained.	Justification: No issues noted.
		M	Trash racks are in place but are unfastened or have bent bars that allow debris to enter into the pipe or pump station, bars are corroded to the point that up to 10% of the sectional area may be lost. Repair or replacement is required.	
		U	Trash racks are missing or damaged to the extent that they are no longer functional and must be replaced. (For example, more than 10% of the sectional area may be lost.)	
		N/A	There are no trash racks, or they are covered in the pump stations section of the report.	
13. Other Metallic Items	A	A	All metal parts are protected from corrosion damage and show no rust, damage, or deterioration that would cause a safety concern.	Justification: No issues noted.
		M	Corrosion seen on metallic parts appears to be maintainable.	
		U	Metallic parts are severely corroded and require replacement to prevent failure, equipment damage, or safety issues.	
		N/A	There are no other significant metallic items.	
14. Riprap Revetments of Inlet/ Discharge Areas	A	A	No riprap displacement or stone degradation that could pose an immediate threat to the integrity of channel bank. Riprap intact with no woody vegetation present.	Justification: No issues noted.
		M	Minor riprap displacement or stone degradation that could pose an immediate threat to the integrity of the channel bank. Unwanted vegetation must be cleared or sprayed with an appropriate herbicide.	
		U	Significant riprap displacement, exposure of bedding, or stone degradation observed. Scour activity is undercutting banks, eroding embankments, or impairing channel flows by causing turbulence or shoaling. Rock protection is hidden by dense brush, trees, or grasses.	
		N/A	There is no riprap protecting this feature of the segment / system, or riprap is discussed in another section.	
15. Revetments other than Riprap	NA	A	No riprap displacement or stone degradation that could pose an immediate threat to the integrity of channel bank. Riprap intact with no woody vegetation present.	
		M	Minor riprap displacement or stone degradation that could pose an immediate threat to the integrity of the channel bank. Unwanted vegetation must be cleared or sprayed with an appropriate herbicide.	
		U	Significant riprap displacement, exposure of bedding, or stone degradation observed. Scour activity is undercutting banks, eroding embankments, or impairing channel flows by causing turbulence or shoaling. Rock protection is hidden by dense brush, trees, or grasses.	
		N/A	There are no such revetments protecting this feature of the segment / system.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

For Official Use Only (FOUO): This document contains levee information that shall not be released in an uncontrolled manner

**Flood Damage Reduction Segments / Systems
Inspection Report**

**Interior Drainage System
Page 4 of 4**

Pump Stations

For use during Initial and Continuing Eligibility Inspections of pump stations

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
1. Pump Stations Operating, Maintenance, Training, & Inspection Records	A	A	Operation, maintenance and inspection records are present at the pump station and are being used and updated, and personnel have been trained in pump station operations. Names and last training date shown in the record book.	Justification: Records present.
		M	Operation, maintenance and inspection records are present but not adequately used and updated.	
		U	No operation, maintenance and inspection records are present, or refresher training for personnel has not been conducted.	
2. Pump Station Operations and Maintenance Equipment Manuals	A	A	Operation and Maintenance Equipment Manuals and/or posted operating instructions are present and updated as required, and adequately cover all pertinent pump station features. O&M manuals include points of contact for manufacturers and suppliers of major equipment used in the facility.	2020-0019 : PS- BA: Operation manuals on site. (A) 2020-0094 : PS-OA: Operation manuals on site. (A) 2020-0097 : PS-CAL: Operation manuals on site. (A) 2020-0109 : PS-HM: Operation manuals on site. (A)
		M	Operation and Maintenance Equipment Manuals and/or posted operating instructions are present and adequately cover all pertinent pump station features. However, they are incomplete and the necessary updates have not been made.	
		U	Operation and Maintenance Equipment Manuals are not available.	
3. Safety Compliance	M	A	Safety compliance inspection reports by applicable local, state, or federal agencies available for review.	2020-0010 : PS-BA: Added confined space label. (A) 2020-0022 : PS-BA: Added arc flash warning labels. (A) 2020-0037 : PS-CAL: Emergency lighting fixed. (A) 2020-0040 : PS-CAL: Added confined space label. (A) 2020-0052 : PS-CAL: Added arc flash warning label. (A) 2020-0082 : PS-OA: Needs a confined space warning label. (M) 2020-0091 : PS-OA: Added arc flash warning labels. (A) 2020-0112 : PS-HM: Added arc flash warning labels. (A) 2020-0115 : PS-HM: Added confined space warning label. (A) 2020-0118 : PS-HM: Needs confined space warning label and the chain needs to be up when not in use. (M)
		M	No safety compliance inspection reports are available for review.	
4. Communications (A or M only)	A	A	A telephone, cellular phone, two-way radio, or similar device is available to pump station operator and maintenance personnel.	Justification: A telephone, cellular phone, two-way radio, or similar device is available to pump station operator and maintenance personnel.
		M	A telephone, cellular phone, two-way radio, or similar device is not available to pump station operator and maintenance personnel.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Pump Stations

For use during Initial and Continuing Eligibility Inspections of pump stations

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
5. Plant Building	M	A	The building is in good structural condition with no major foundation settlement problems. The roof is not leaking, intake & exhaust louvers are clear of debris, fans are operational, etc.	2020-0007 : PS-BA: Peeling paint on northern exterior wall. (M) 2020-0013 : PS-BA: Broken masonry. (M) 2020-0016 : PS-BA: Broken concrete and masonry around doorway. (M) 2020-0025 : PS-BA: Grounding wire needs to be reattached. (M) 2020-0028 : PS-CAL: Peeling paint on ceiling. Crack in concrete. (M) 2020-0031 : PS-CAL: Cracked concrete around skylight. Peeling weatherstrip. (M) 2020-0046 : PS-CAL: Cracks in masonry all around the pump station. (M) 2020-0049 : PS-CAL: Concrete missing around the skylight. (M) 2020-0064 : PS-CAL: Broken sidewalk. (M) 2020-0067 : PS-CAL: Chipped foundation at corner. (M) 2020-0073 : PS-CAL: Broken masonry on corner. (M) 2020-0079 : PS-OA: Splitting in the joint sealant. (M) 2020-0085 : PS-OA: Cracking of masonry around pipe. (M) 2020-0100 : PS-OA: Cracking in masonry. (M) 2020-0103 : PS-OA: Cracking in masonry. High importance. (M) 2020-0124 : PS-HM: Cracking in masonry around all windows. (M) 2020-0133 : PS-HM: Cracked masonry repaired and new paint added. (A)
		M	There are minor structural defects, minimal foundation settlement, leaks, or other conditions noted that need repair. Defects do not threaten the structural integrity or stability of the building, and will not impact pumping operations.	
		U	The structural integrity or stability of the building is threatened, or there is damage to the building that threatens safety of the operator or impacts pumping operations.	
6. Fencing and Gates	M	A	Fencing is in good condition and provides protection against falling or unauthorized access. Gates open and close freely, locks are in place, and there is little corrosion on metal parts.	2020-0070 : PS-CAL: Broken fence. (M) 2020-0106 : PS-OA: Broken fence. (M)
		M	Fencing or gates are damaged or corroded but appear to be maintainable. Locks may be missing or damaged.	
		U	Fencing and gates are damaged or corroded to the point that replacement is required, or potentially dangerous features are not secured.	
		N/A	There are no features noted that require safety fencing.	
7. Pumps ¹	M	A	All pumps are properly maintained and lubricated. Systems are periodically tested and documented for review. No vibration, cavitation noises or unusual sounds are noted when the pump is operated. Bearing temperature sensor records don't indicate any problems.	2020-0034 : Ps-dwp1 out of operation (M)
		M	Minor deficiencies noted that need to be closely monitored or repaired, such as the presence of slight vibrations, leakage of packing gland, bearing temperature sensors are inoperable or no record is present. However, the pumps are operational and are expected to perform through the next period of usage.	
		U	Major deficiencies identified that may significantly reduce pumping operations. For example, bearing sensor records indicate problems, excessive vibration noted, impellers are badly corroded, or there are eroded or missing blades.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Pump Stations

For use during Initial and Continuing Eligibility Inspections of pump stations

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
8. Motors, Engines, Fans, Gear Reducers, Back Stop Devices, etc.	M	A	All items are operational. Preventative maintenance and lubrication is being performed and the system is periodically subjected to performance testing. Instrumentation, alarms, bearing sensors and auto shutdowns are operational.	2020-0130 : PS-HM: Vent not in operation. (M)
		M	Systems have minor deficiencies, but are operational and will function adequately through the next flood. Bearing sensors are not operational.	
		U	One or more of the primary motors or systems is not operational, or noted deficiencies have not been corrected.	
9. Sumps / Wet well	A	A	Clear of debris, sediment, or other obstructions. Procedures are in place to remove debris accumulation during operation.	Justification: No issues noted.
		M	Debris, sediment, or other obstructions may be present and must be removed, but the sump/ wet well will function as intended during the next flood. Procedures are in place to remove debris accumulation during operation.	
		U	Large debris or excessive silt present which will hinder or damage pumps during operation, or no procedures established to remove debris accumulation during operation.	
10. Mechanical Operating Trash Rakes ¹	M	A	Drive chain, bearing, gear reducers, and other components are in good operating condition and are being properly maintained.	2020-0055 : PS-CAL: Replaced the corroded trash rack members. (A) 2020-0058 : PS-CAL: Foundation crumbling. (M) 2020-0061 : PS-CAL: Casing corroded. (M)
		M	The trash rake is in need of maintenance, but is still operational.	
		U	Trash rake not operational or deficiencies will inhibit operations during the next flood event.	
		N/A	There are no mechanical trash rakes.	
11. Non-Mechanical Trash Racks	A	A	Trash racks are fastened in place and properly maintained.	Justification: No issues noted.
		M	Trash racks are in place but are unfastened or have bent bars that allow debris to enter into the pipe or pump station, bars are corroded to the point that up to 10% of the sectional area may be lost. Repair or replacement is required.	
		U	Trash racks are missing or damaged to the extent that they are no longer functional and must be replaced. (For example, more than 10% of the sectional area may be lost.)	
		N/A	There are no trash racks, or they are covered in the pump stations section of the report.	
12. Fuel System for Pump Engines	A	A	Fuel system is operational, day tank present and operational, fuel fresh and rotated regularly.	Justification: No issues noted.
		M	Fuel system is operational and of adequate capacity, but day tank is missing or fuel is not fresh and rotated regularly.	
		U	Fuel system not functional.	
		N/A	No fuel system.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Pump Stations

For use during Initial and Continuing Eligibility Inspections of pump stations

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
13. Power Source	A	A	The normal power source and backup generators, if installed, are operational, properly exercised and well maintained. Surge protection, grounding, lightning protection, transformers, and automatic/manual transfer of main power to backup system is working.	Justification: No issues noted.
		M	Normal power source and backup units, if applicable, are operational with minor discrepancies or maintenance, inspection and exercising record is present but not up to date. Preventative maintenance or repairs are required.	
		U	Normal power source or generators are not operational and must be repaired; or generator, if required, is not on site.	
14. Electrical Systems	A	A	Operational and maintained free of damage, corrosion, and debris. Preventative maintenance and system testing is being performed periodically.	Justification: No issues noted.
		M	Operational with minor discrepancies. Preventative maintenance or repairs are required, but the components are expected to function adequately during the next flood event.	
		U	Components of the electrical system will not function adequately during the next flood event and must be replaced.	
15. Megger Testing on Pump Motors and Critical Power Cables	M	A	Results of megger tests on pump motors or critical power cables show that the insulation meets manufacturer's or industry standards. Tested within the last year.	Justification: Megger testing last performed in 2018. No major issues reported.
		M	Megger testing not conducted within the past year. If megger tests on pump motors indicate that insulation resistance is below the manufacturer's or industry standard, but the resistance can be corrected with proper application of heat, this is minimally acceptable. (The application of heat does not relate to critical power cables.)	
		U	Megger tests not conducted within past two years, or tests indicate that insulation resistance is low enough that the equipment will not be able to meet design standards of operation; or evidence of arcing or shorting is detected visually.	
16. Enclosures, Panels, Conduit and Ducts	M	A	All enclosures, panels, conduits, and ducts are protected from corrosion damage and show no rust, damage, or deterioration that would cause a safety concern.	2020-0043 : PS-CAL: Missing cover on elbow. (M) 2020-0076 : PS-CAL: Corroded screen. (M) 2020-0088 : PS-OA: Pipe insulation peeling. (M)
		M	Minor surface corrosion which appears to be maintainable. Cleaning and painting required.	
		U	Severely corroded and must be replaced to prevent failure, equipment damage, or safety issues.	
17. Intake and Discharge Pipelines	A	A	Intake and discharge pipelines have no corrosion and paint is intact, except for minor touch up required. Pipe couplings and anchors have no leakage or corrosion.	Justification: No issues noted.
		M	Intake and discharge pipelines have minor corrosion and repair and painting is required. Pipe coupling with anchors have minor leakage, corrosion and require bolts to be tightened.	
		U	Intake and discharge pipelines have major corrosion and replacement is required. Pipe coupling with anchors have major leakage and is heavily corroded and requires replacement.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

Pump Stations

For use during Initial and Continuing Eligibility Inspections of pump stations

Rated Item	Rating	Rating Guidelines		Location/Remarks/Recommendations
18. Sluice/ Slide Gates ³	A	A	Gates open and close freely to a tight seal or minor leakage. Gate operators are in good working condition and are properly maintained. Sill is free of sediment and other obstructions. Gates and lifters have been maintained and are free of corrosion. Documentation provided during the inspection.	Justification: No issues noted.
		M	Gates and/or operators have been damaged or have minor corrosion, and open and close with resistance or binding. Leakage quantity is controllable, but maintenance is required. Sill is free of sediment and other obstructions.	
		U	Gates do not open or close and/or operators do not function. Gate, stem, lifter and/or guides may be damaged or have major corrosion.	
		N/A	There are no sluice/ slide gates.	
19. Flap Gates/ Flap Valves/ Pinch Valves ¹	A	A	Gates/ valves open and close easily with minimal leakage, have no corrosion damage, and have been exercised and lubricated as required.	Justification: No issues noted.
		M	Gates/ valves will not fully open or close because of obstructions that can be easily removed, or have minor corrosion damage that requires maintenance.	
		U	Gates/ valves are missing, have been damaged, or have deteriorated to the point that they need to be replaced.	
		N/A	There are no gates on discharge lines from pump station.	
20. Cranes ¹	A	A	Cranes operational and have been inspected and load tested in accordance with applicable standards within the last year. Documentation is on hand.	Justification: No issues noted.
		M	Cranes have not been inspected or operationally tested within the past year, or there are visible signs of corrosion, oil leakage, etc, requiring maintenance.	
		U	Cranes are not operational, and this may prevent the pump station from functioning as required. No documentation available on cranes.	
		N/A	There are no cranes.	
21. Other Metallic Items (Equipment, Ladders, Platform Anchors, etc)	M	A	All metal parts are protected from corrosion damage and show no rust, damage, or deterioration that would cause a safety concern.	2020-0121 : PS-HM: Pipe from roof drain is heavily corroded. (M) 2020-0127 : PS-HM: Corrosion on pipes. (M)
		M	Corrosion seen on metallic parts appears to be maintainable.	
		U	Metallic parts are severely corroded and require replacement to prevent failure, equipment damage, or safety issues.	
		N/A	There are no other significant metallic items.	

Key: A = Acceptable. M = Minimally Acceptable; Maintenance is required. U = Unacceptable. N/A = Not Applicable. FDR = Flood Damage Reduction

For Official Use Only (FOUO): This document contains levee information that shall not be released in an uncontrolled manner

**Flood Damage Reduction Segments / Systems
Inspection Report**

**Pump Stations
Page 5 of 5**

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0089 **Title:**

2604000009_CELRC_2020_A_0089_1_20200706T154758.jpg **Rated**

Item: 2. Emergency Supplies and Equipment (A or M only) **Caption:**

Acceptable - Supply material and empty sand bags. Around 126000 bags.



Inspect ID: 2020-0092 **Title:**

2604000009_CELRC_2020_A_0092_1_20200706T155937.jpg **Rated**

Item: 2. Emergency Supplies and Equipment (A or M only) **Caption:**

Acceptable - Filled sand bags and bags of sand. 14 boxed cases (10000 empty bags per box.) and roughly 20 pallets of filled sandbags. About 11 mega bags of sand

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0092 **Title:** 2604000009_CELRC_2020_A_2020-0092_2_20200706T160129.jpg **Rated Item:** 2. Emergency Supplies and Equipment (A or M only) **Caption:** Acceptable - Filled sand bags and bags of sand. 14 boxed cases (10000 empty bags per box.) and roughly 20 pallets of filled sandbags. About 11 mega bags of sand



Inspect ID: 2020-0092 **Title:** 2604000009_CELRC_2020_A_2020-0092_3_20200706T160337.jpg **Rated Item:** 2. Emergency Supplies and Equipment (A or M only) **Caption:** Acceptable - Filled sand bags and bags of sand. 14 boxed cases (10000 empty bags per box.) and roughly 20 pallets of filled sandbags. About 11 mega bags of sand

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0045 **Title:** 2604000009_CELRC_2020_A_0045_1_20200706T133621.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Vegetation close to riverside toe.



Inspect ID: 2020-0300 **Title:** 2604000009_CELRC_2020_A_0300_1_20200706T153010.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0312 **Title:** 2604000009_CELRC_2020_A_0312_1_20200706T153909.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Tall vegetation on riverside toe.



Inspect ID: 2020-0315 **Title:** 2604000009_CELRC_2020_A_0315_1_20200706T153950.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Tall vegetation on landside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0321 **Title:** 2604000009_CELRC_2020_A_0321_1_20200706T154222.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees and tall vegetation on landside toe and slope.



Inspect ID: 2020-0327 **Title:** 2604000009_CELRC_2020_A_0327_1_20200706T154354.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Bushes on landside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems





Inspect ID: 2020-0333 **Title:** 2604000009_CELRC_2020_A_0333_1_20200706T154516.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Large trees on landside toe.



Inspect ID: 2020-0342 **Title:** 2604000009_CELRC_2020_A_0342_1_20200706T154823.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Tall vegetation on landside slope.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

	<p>Inspect ID: 2020-0384 Title: 2604000009_CELRC_2020_A_0384_1_20200706T160800.jpg Rated Item: 1. Unwanted Vegetation Growth Caption: Minimally Acceptable - Tall vegetation on riverside toe.</p>
	<p>Inspect ID: 2020-0387 Title: 2604000009_CELRC_2020_A_0387_1_20200706T161244.jpg Rated Item: 1. Unwanted Vegetation Growth Caption: Minimally Acceptable - Trees and tall vegetation on riverside toe.</p>

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0396 **Title:** 2604000009_CELRC_2020_A_0396_1_20200706T161627.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees and tall vegetation on riverside toe.



Inspect ID: 2020-0399 **Title:** 2604000009_CELRC_2020_A_0399_1_20200706T161801.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0405 **Title:** 2604000009_CELRC_2020_A_0405_1_20200706T162242.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside toe.



Inspect ID: 2020-0417 **Title:** 2604000009_CELRC_2020_A_0417_1_20200706T163242.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0420 **Title:** 2604000009_CELRC_2020_A_0420_1_20200706T163432.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside toe.



Inspect ID: 2020-0033 **Title:** 2604000009_CELRC_2020_A_0033_1_20200706T132249.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Large log on riverside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0309 **Title:** 2604000009_CELRC_2020_A_0309_1_20200706T153831.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Downed tree on landside toe and slope.



Inspect ID: 2020-0324 **Title:** 2604000009_CELRC_2020_A_0324_1_20200706T154301.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Garden on landside slope.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0330 **Title:** 2604000009_CELRC_2020_A_0330_1_20200706T154438.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Fence on landside toe.



Inspect ID: 2020-0336 **Title:** 2604000009_CELRC_2020_A_0336_1_20200706T154548.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Small fence on landside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0339 **Title:** 2604000009_CELRC_2020_A_0339_1_20200706T154629.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Fence on landside toe.



Inspect ID: 2020-0423 **Title:** 2604000009_CELRC_2020_A_0423_1_20200706T163652.jpg **Rated Item:** 3. Encroachments **Caption:** Minimally Acceptable - Sign on levee crest.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

	<p>Inspect ID: 2020-0042 Title: 2604000009_CELRC_2020_A_0042_1_20200706T133243.jpg Rated Item: 8. Depressions/ Rutting Caption: Minimally Acceptable - Rutting on riverside slope.</p>
	<p>Inspect ID: 2020-0318 Title: 2604000009_CELRC_2020_A_0318_1_20200706T154057.jpg Rated Item: 8. Depressions/ Rutting Caption: Minimally Acceptable - Rutting on landside slope.</p>

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0390 **Title:** 2604000009_CELRC_2020_A_0390_1_20200706T161441.jpg **Rated Item:** 8. Depressions/ Rutting **Caption:** Minimally Acceptable - Rutting on landside toe.



Inspect ID: 2020-0393 **Title:** 2604000009_CELRC_2020_A_0393_1_20200706T161557.jpg **Rated Item:** 8. Depressions/ Rutting **Caption:** Minimally Acceptable - Rutting near landside toe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0036 **Title:** 2604000009_CELRC_2020_A_0036_1_20200706T132619.jpg **Rated Item:** 10. Animal Control **Caption:** Minimally Acceptable - Tiny burrow in crest, one inch diameter, 3 inches deep.



Inspect ID: 2020-0039 **Title:** 2604000009_CELRC_2020_A_0039_1_20200706T133048.jpg **Rated Item:** 10. Animal Control **Caption:** Minimally Acceptable - Holes on riverside slope.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0402 **Title:** 2604000009_CELRC_2020_A_0402_1_20200706T161910.jpg **Rated Item:** 13. Revetments other than Riprap **Caption:** Minimally Acceptable - Slight tilting of retaining wall on landside.



Inspect ID: 2020-0012 **Title:** 2604000009_CELRC_2020_A_0012_1_20200828T193240.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems





Inspect ID: 2020-0030 **Title:** 2604000009_CELRC_2020_A_0030_1_20200706T131924.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Vegetation on riverside.



Inspect ID: 2020-0063 **Title:** 2604000009_CELRC_2020_A_0063_1_20200706T134522.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

	<p>Inspect ID: 2020-0072 Title: 2604000009_CELRC_2020_A_0072_1_20200706T135017.jpg Rated Item: 1. Unwanted Vegetation Growth Caption: Minimally Acceptable - Tall vegetation and trees close to riverside of wall.</p>
	<p>Inspect ID: 2020-0096 Title: 2604000009_CELRC_2020_A_0096_1_20200706T135945.jpg Rated Item: 1. Unwanted Vegetation Growth Caption: Minimally Acceptable - Two small trees close to wall.</p>

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0099 **Title:** 2604000009_CELRC_2020_A_0099_1_20200706T140057.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Small tree near wall.



Inspect ID: 2020-0111 **Title:** 2604000009_CELRC_2020_A_0111_1_20200706T140653.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Tree on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0171 **Title:** 2604000009_CELRC_2020_A_0171_1_20200706T143931.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Large trees on riverside.



Inspect ID: 2020-0234 **Title:** 2604000009_CELRC_2020_A_0234_1_20200706T150434.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Trees on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0297 **Title:** 2604000009_CELRC_2020_A_0297_1_20200706T152915.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Vegetation on landside.



Inspect ID: 2020-0345 **Title:** 2604000009_CELRC_2020_A_0345_1_20200706T154929.jpg **Rated Item:** 1. Unwanted Vegetation Growth **Caption:** Minimally Acceptable - Small trees close to wall.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0114 **Title:** 2604000009_CELRC_2020_A_0114_1_20200706T140918.jpg **Rated Item:** 2. Encroachments **Caption:** Minimally Acceptable - Downed tree in riprap on riverside.



Inspect ID: 2020-0117 **Title:** 2604000009_CELRC_2020_A_0117_1_20200706T141213.jpg **Rated Item:** 2. Encroachments **Caption:** Minimally Acceptable - Grass clippings on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0210 **Title:** 2604000009_CELRC_2020_A_0210_1_20200706T145408.jpg **Rated Item:** 2. Encroachments **Caption:** Minimally Acceptable - Downed tree on wall.



Inspect ID: 2020-0228 **Title:** 2604000009_CELRC_2020_A_0225_1_20200706T150131.jpg **Rated Item:** 2. Encroachments **Caption:** Minimally Acceptable - Debris next to wall on riverside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0264 **Title:** 2604000009_CELRC_2020_A_0264_1_20200706T151514.jpg **Rated Item:** 2. Encroachments **Caption:** Minimally Acceptable - Debris on landside



Inspect ID: 2020-0303 **Title:** 2604000009_CELRC_2020_A_0303_1_20200706T153304.jpg **Rated Item:** 2. Encroachments **Caption:** Minimally Acceptable - Debris on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0018 **Title:** 2604000009_CELRC_2020_A_0018_1_20200706T131239.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Spalling on cap.



Inspect ID: 2020-0021 **Title:** 2604000009_CELRC_2020_A_0021_1_20200706T131347.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Spalling, exposed waterstop.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0027 **Title:** 2604000009_CELRC_2020_A_0027_1_20200706T131659.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Exposed rebar on landside.



Inspect ID: 2020-0048 **Title:** 2604000009_CELRC_2020_A_0048_1_20200706T133726.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Crack through levee.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0051 **Title:** 2604000009_CELRC_2020_A_0051_1_20200706T133946.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Minor spalling on cap.



Inspect ID: 2020-0054 **Title:** 2604000009_CELRC_2020_A_0054_1_20200706T134211.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Crack on landside pillar.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0057 **Title:** 2604000009_CELRC_2020_A_0057_1_20200706T134337.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Crack on landside.



Inspect ID: 2020-0060 **Title:** 2604000009_CELRC_2020_A_0060_1_20200706T134447.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Crack on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0066 **Title:** 2604000009_CELRC_2020_A_0066_1_20200706T134629.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Crack on wingwall on landside.



Inspect ID: 2020-0105 **Title:** 2604000009_CELRC_2020_A_0105_1_20200828T191650.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Spalling on cap.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0147 **Title:** 2604000009_CELRC_2020_A_0147_1_20200828T191849.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Exposed rebar on cap.



Inspect ID: 2020-0231 **Title:** 2604000009_CELRC_2020_A_0231_1_20200706T150313.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Exposed rebar in cap.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0306 **Title:** 2604000009_CELRC_2020_A_0306_1_20200706T153726.jpg **Rated Item:** 4. Concrete Surfaces **Caption:** Minimally Acceptable - Broken cap at transition.



Inspect ID: 2020-0243 **Title:** 2604000009_CELRC_2020_A_0243_1_20200828T164825.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Holes on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0282 **Title:** 2604000009_CELRC_2020_A_0282_1_20200706T152034.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - 3.5 ft burrow leading to wall on landside.



Inspect ID: 2020-0291 **Title:** 2604000009_CELRC_2020_A_0291_1_20200828T165630.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Holes on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0351 **Title:** 2604000009_CELRC_2020_A_0351_1_20200828T165710.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Holes on landside.



Inspect ID: 2020-0357 **Title:** 2604000009_CELRC_2020_A_0357_1_20200706T155342.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Hole at wall transition.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0360 **Title:** 2604000009_CELRC_2020_A_0360_1_20200706T155618.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Hole at wall transition.



Inspect ID: 2020-0369 **Title:** 2604000009_CELRC_2020_A_0369_1_20200828T165801.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Holes on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0372 **Title:** 2604000009_CELRC_2020_A_0372_1_20200706T155942.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Hole at wall transition.



Inspect ID: 2020-0375 **Title:** 2604000009_CELRC_2020_A_0375_1_20200706T160138.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Hole at transition

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0378 **Title:** 2604000009_CELRC_2020_A_0378_1_20200706T160314.jpg **Rated Item:** 6. Foundation of Concrete Structures **Caption:** Minimally Acceptable - Holes on landside.



Inspect ID: 2020-0015 **Title:** 2604000009_CELRC_2020_A_0015_1_20200706T131129.jpg **Rated Item:** 7. Monolith Joints **Caption:** Minimally Acceptable - Deteriorating sealant on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0084 **Title:** 2604000009_CELRC_2020_A_0084_1_20200828T170624.jpg **Rated Item:** 7. Monolith Joints **Caption:** Minimally Acceptable - Deteriorating sealant on landside.



Inspect ID: 2020-0093 **Title:** 2604000009_CELRC_2020_A_0093_1_20200706T135820.jpg **Rated Item:** 7. Monolith Joints **Caption:** Minimally Acceptable - Filler material exposed in cap.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems




Inspect ID: 2020-0126 **Title:** 2604000009_CELRC_2020_A_0126_1_20200706T141546.jpg **Rated Item:** 7. Monolith Joints **Caption:** Minimally Acceptable - Deteriorating sealant at bottom on landside.



Inspect ID: 2020-0144 **Title:** 2604000009_CELRC_2020_A_0144_1_20200706T142232.jpg **Rated Item:** 7. Monolith Joints **Caption:** Minimally Acceptable - Deteriorating sealant on landside.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

	<p>Inspect ID: 2020-0195 Title: 2604000009_CELRC_2020_A_0195_1_20200828T170841.jpg Rated Item: 7. Monolith Joints Caption: Minimally Acceptable - Deteriorating joints.</p>
	<p>Inspect ID: 2020-0020 Title: 2604000009_CELRC_2020_A_0020_1_20200706T134447.jpg Rated Item: 1. Vegetation and Obstructions Caption: Minimally Acceptable - MU-9: Overgrown vegetation at outlet.</p>

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0044 **Title:** 2604000009_CELRC_2020_A_0044_1_20200706T142530.jpg **Rated Item:** 1. Vegetation and Obstructions **Caption:** Minimally Acceptable - MU-5: Vegetation at gateway.



Inspect ID: 2020-0068 **Title:** 2604000009_CELRC_2020_A_0068_1_20200706T144835.jpg **Rated Item:** 1. Vegetation and Obstructions **Caption:** Minimally Acceptable - MU-3: Heavy vegetation at outlet.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0408 **Title:** 2604000009_CELRC_2020_A_0408_1_20200706T162732.jpg **Rated Item:** 1. Vegetation and Obstructions **Caption:** Minimally Acceptable - MU-3: Outlet blocked with silt.



Inspect ID: 2020-0411 **Title:** 2604000009_CELRC_2020_A_0411_1_20200706T163031.jpg **Rated Item:** 1. Vegetation and Obstructions **Caption:** Minimally Acceptable - MU-3: Small trees around gatewell.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0414 **Title:** 2604000009_CELRC_2020_A_0414_1_20200706T163108.jpg **Rated Item:** 1. Vegetation and Obstructions **Caption:** Minimally Acceptable - MU-3: Vegetation around inlet.



Inspect ID: 2020-0426 **Title:** 2604000009_CELRC_2020_A_0426_1_20200714T132259.jpg **Rated Item:** 1. Vegetation and Obstructions **Caption:** Minimally Acceptable - MU-12: Vegetation at outlet.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0014 **Title:** 2604000009_CELRC_2020_A_0014_1_20200706T132159.jpg **Rated Item:** 10. Sluice/ Slide Gates **Caption:** Minimally Acceptable - MU-11: Gate not closed all the way. Sediment within gatewell.



Inspect ID: 2020-0056 **Title:** 2604000009_CELRC_2020_A_0056_1_20200706T143326.jpg **Rated Item:** 10. Sluice/ Slide Gates **Caption:** Minimally Acceptable - MU-4: Sluice gate completely closed. Debris on sluice gate.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0074 **Title:** 2604000009_CELRC_2020_A_0074_1_20200706T145859.jpg **Rated Item:** 10. Sluice/ Slide Gates **Caption:** Minimally Acceptable - MU-2: Gate closed completely. Debris around sluice gate.



Inspect ID: 2020-0086 **Title:** 2604000009_CELRC_2020_A_0086_1_20200706T153036.jpg **Rated Item:** 10. Sluice/ Slide Gates **Caption:** Minimally Acceptable - MU-1: Sluice gate closed completely but guide rail is bent.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0011 **Title:**
2604000009_CELRC_2020_A_0011_1_20200706T131336.jpg **Rated**
Item: 11. Flap Gates/ Flap Valves/ Pinch Valves **Caption:** Acceptable -
MU-11: Water covering outlet structure. Unable to verify.



Inspect ID: 2020-0065 **Title:**
2604000009_CELRC_2020_A_0065_1_20200706T144629.jpg **Rated**
Item: 11. Flap Gates/ Flap Valves/ Pinch Valves **Caption:** Minimally
Acceptable - MU-3: Flap gate not closed fully.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0019 **Title:** 2604000009_CELRC_2020_A_0019_1_20200706T143154.jpg **Rated Item:** 2. Pump Station Operations and Maintenance Equipment Manuals **Caption:** Acceptable - PS- BA: Operation manuals on site.



Inspect ID: 2020-0094 **Title:** 2604000009_CELRC_2020_A_0094_1_20200706T152939.jpg **Rated Item:** 2. Pump Station Operations and Maintenance Equipment Manuals **Caption:** Acceptable - PS-OA: Operation manuals on site.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0109 **Title:** 2604000009_CELRC_2020_A_0109_1_20200706T154623.jpg **Rated Item:** 2. Pump Station Operations and Maintenance Equipment Manuals **Caption:** Acceptable - PS-HM: Operation manuals on site.



Inspect ID: 2020-0010 **Title:** 2604000009_CELRC_2020_A_0010_1_20200706T142753.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-BA: Added confined space label.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0022 **Title:** 2604000009_CELRC_2020_A_0022_1_20200706T143313.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-BA: Added arc flash warning labels.



Inspect ID: 2020-0037 **Title:** 2604000009_CELRC_2020_A_0037_1_20200706T145305.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-CAL: Emergency lighting fixed.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0040 **Title:** 2604000009_CELRC_2020_A_0040_1_20200706T145340.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-CAL: Added confined space label.



Inspect ID: 2020-0052 **Title:** 2604000009_CELRC_2020_A_0052_1_20200706T150156.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-CAL: Added arc flash warning label.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0082 **Title:** 2604000009_CELRC_2020_A_0082_1_20200706T152541.jpg **Rated Item:** 3. Safety Compliance **Caption:** Minimally Acceptable - PS-OA: Needs a confined space warning label.




Inspect ID: 2020-0091 **Title:** 2604000009_CELRC_2020_A_0091_1_20200706T152901.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-OA: Added arc flash warning labels.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0112 **Title:** 2604000009_CELRC_2020_A_0112_1_20200706T154716.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-HM: Added arc flash warning labels.

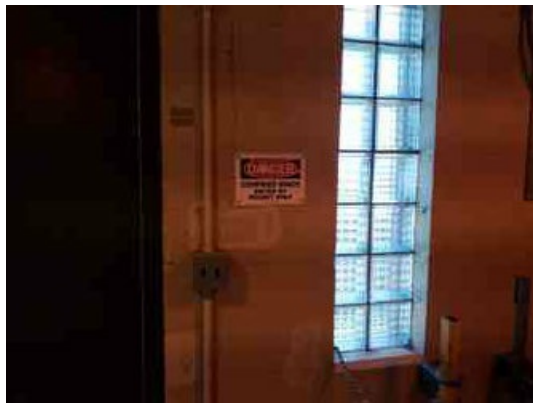

Inspect ID: 2020-0115 **Title:** 2604000009_CELRC_2020_A_0115_1_20200706T154900.jpg **Rated Item:** 3. Safety Compliance **Caption:** Acceptable - PS-HM: Added confined space warning label.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems





Inspect ID: 2020-0118 **Title:** 2604000009_CELRC_2020_A_0118_1_20200706T155114.jpg **Rated Item:** 3. Safety Compliance **Caption:** Minimally Acceptable - PS-HM: Needs confined space warning label and the chain needs to be up when not in use.



Inspect ID: 2020-0007 **Title:** 2604000009_CELRC_2020_A_0007_1_20200706T142623.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-BA: Peeling paint on northern exterior wall.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

	Inspect ID: 2020-0013 Title: 2604000009_CELRC_2020_A_0013_1_20200706T142902.jpg Rated Item: 5. Plant Building Caption: Minimally Acceptable - PS-BA: Broken masonry.
	Inspect ID: 2020-0016 Title: 2604000009_CELRC_2020_A_0016_1_20200706T143055.jpg Rated Item: 5. Plant Building Caption: Minimally Acceptable - PS-BA: Broken concrete and masonry around doorway.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0025 **Title:** 2604000009_CELRC_2020_A_0025_1_20200706T143519.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-BA: Grounding wire needs to be reattached.



Inspect ID: 2020-0028 **Title:** 2604000009_CELRC_2020_A_0028_1_20200706T144915.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL: Peeling paint on ceiling. Crack in concrete.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0031 **Title:** 2604000009_CELRC_2020_A_0031_1_20200706T145009.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL: Cracked concrete around skylight. Peeling weatherstrip.




Inspect ID: 2020-0046 **Title:** 2604000009_CELRC_2020_A_0046_1_20200706T145924.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL: Cracks in masonry all around the pump station.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0049 **Title:** 2604000009_CELRC_2020_A_0049_1_20200706T150113.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL: Concrete missing around the skylight.

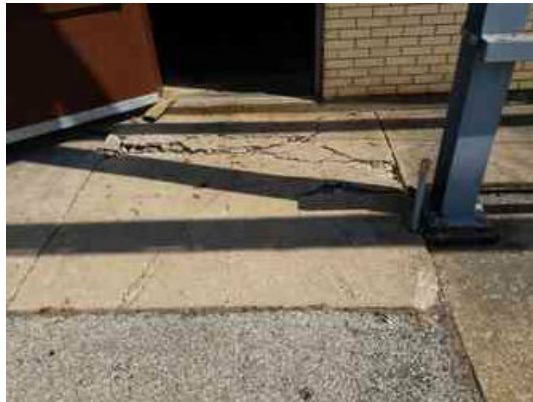

Inspect ID: 2020-0064 **Title:** 2604000009_CELRC_2020_A_0064_1_20200706T150752.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL: Broken sidewalk.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0067 **Title:**
2604000009_CELRC_2020_A_0067_1_20200706T150857.jpg **Rated**
Item: 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL:
Chipped foundation at corner.



Inspect ID: 2020-0073 **Title:**
2604000009_CELRC_2020_A_0073_1_20200706T151128.jpg **Rated**
Item: 5. Plant Building **Caption:** Minimally Acceptable - PS-CAL: Broken
masonry on corner.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0079 **Title:** 2604000009_CELRC_2020_A_0079_1_20200706T152441.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-OA: Splitting in the joint sealant.



Inspect ID: 2020-0085 **Title:** 2604000009_CELRC_2020_A_0085_1_20200706T152651.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-OA: Cracking of masonry around pipe.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems

	Inspect ID: 2020-0100 Title: 2604000009_CELRC_2020_A_0100_1_20200706T153146.jpg Rated Item: 5. Plant Building Caption: Minimally Acceptable - PS-OA: Cracking in masonry.
	Inspect ID: 2020-0103 Title: 2604000009_CELRC_2020_A_0103_1_20200706T153348.jpg Rated Item: 5. Plant Building Caption: Minimally Acceptable - PS-OA: Cracking in masonry. High importance.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0124 **Title:** 2604000009_CELRC_2020_A_0124_1_20200706T155426.jpg **Rated Item:** 5. Plant Building **Caption:** Minimally Acceptable - PS-HM: Cracking in masonry around all windows.



Inspect ID: 2020-0133 **Title:** 2604000009_CELRC_2020_A_0133_1_20200706T160006.jpg **Rated Item:** 5. Plant Building **Caption:** Acceptable - PS-HM: Cracked masonry repaired and new paint added.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0070 **Title:** 2604000009_CELRC_2020_A_0070_1_20200706T151028.jpg **Rated Item:** 6. Fencing and Gates **Caption:** Minimally Acceptable - PS-CAL: Broken fence.




Inspect ID: 2020-0106 **Title:** 2604000009_CELRC_2020_A_0106_1_20200706T153621.jpg **Rated Item:** 6. Fencing and Gates **Caption:** Minimally Acceptable - PS-OA: Broken fence.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0034 **Title:** 2604000009_CELRC_2020_A_0034_1_20200706T145133.jpg **Rated**
Item: 7. Pumps **Caption:** Minimally Acceptable - Ps-dwp1 out of operation

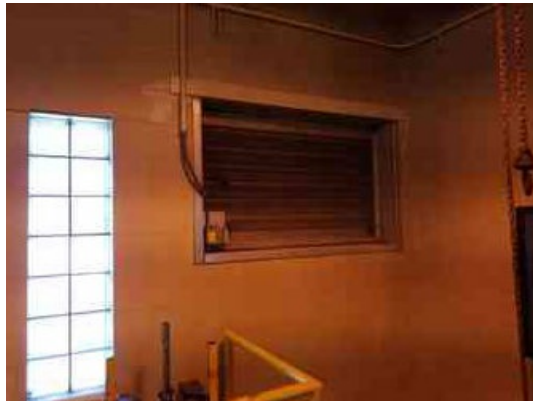


Inspect ID: 2020-0130 **Title:** 2604000009_CELRC_2020_A_0130_1_20200706T155819.jpg **Rated**
Item: 8. Motors, Engines, Fans, Gear Reducers, Back Stop Devices, etc.
Caption: Minimally Acceptable - PS-HM: Vent not in operation.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0055 **Title:** 2604000009_CELRC_2020_A_0055_1_20200706T150410.jpg **Rated Item:** 10. Mechanical Operating Trash Rakes **Caption:** Acceptable - PS-CAL: Replaced the corroded trash rack members.

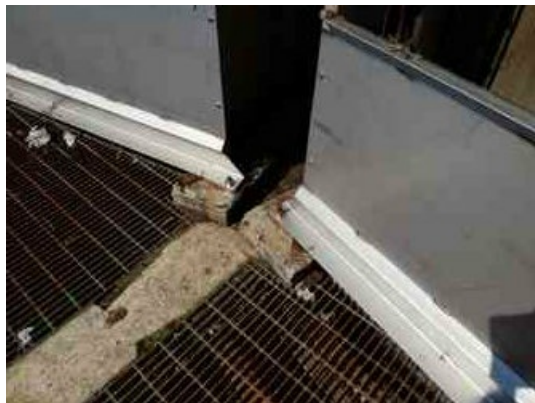

Inspect ID: 2020-0058 **Title:** 2604000009_CELRC_2020_A_0058_1_20200706T150541.jpg **Rated Item:** 10. Mechanical Operating Trash Rakes **Caption:** Minimally Acceptable - PS-CAL: Foundation crumbling.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0061 **Title:** 2604000009_CELRC_2020_A_0061_1_20200706T150629.jpg **Rated Item:** 10. Mechanical Operating Trash Rakes **Caption:** Minimally Acceptable - PS-CAL: Casing corroded.




Inspect ID: 2020-0043 **Title:** 2604000009_CELRC_2020_A_0043_1_20200706T145443.jpg **Rated Item:** 16. Enclosures, Panels, Conduit and Ducts **Caption:** Minimally Acceptable - PS-CAL: Missing cover on elbow.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0076 **Title:** 2604000009_CELRC_2020_A_0076_1_20200706T151318.jpg **Rated Item:** 16. Enclosures, Panels, Conduit and Ducts **Caption:** Minimally Acceptable - PS-CAL: Corroded screen.

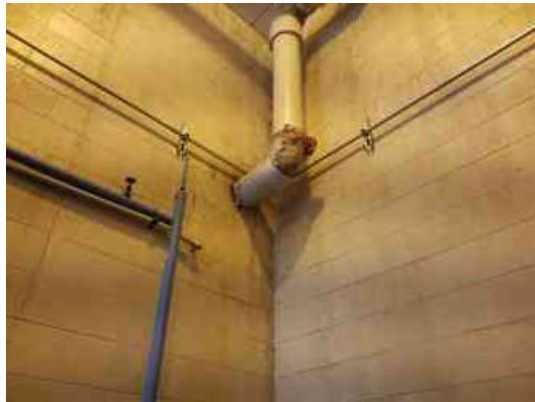

Inspect ID: 2020-0088 **Title:** 2604000009_CELRC_2020_A_0088_1_20200706T152744.jpg **Rated Item:** 16. Enclosures, Panels, Conduit and Ducts **Caption:** Minimally Acceptable - PS-OA: Pipe insulation peeling.

Photos

For use during Initial and Continuing Eligibility Inspections of levee segments / systems



Inspect ID: 2020-0121 **Title:** 2604000009_CELRC_2020_A_0121_1_20200706T155327.jpg **Rated Item:** 21. Other Metallic Items (Equipment, Ladders, Platform Anchors, etc) **Caption:** Minimally Acceptable - PS-HM: Pipe from roof drain is heavily corroded.



Inspect ID: 2020-0127 **Title:** 2604000009_CELRC_2020_A_0127_1_20200706T155616.jpg **Rated Item:** 21. Other Metallic Items (Equipment, Ladders, Platform Anchors, etc) **Caption:** Minimally Acceptable - PS-HM: Corrosion on pipes.



**US Army Corps
of Engineers ®**

Flood Damage Reduction System 2605000006 / Segment 2604000009

Public Sponsor Pre-Inspection Form

The following information is to be provided by the levee district sponsor prior to an inspection. This information will be used to help evaluate the organizational capability of the levee district to manage the levee segment / system maintenance program.

1. Levee segment / system and sponsor: (name of the segment / system and levee sponsor) System 2605000006 / Segment 2604000009 CELRC		
2. Reporting period: (month/day/year to month/day/year) 05/06/2019 to 07/06/2020		
3. Summary of maintenance required by last inspection report: Exercise and grease gates, mow.		
4. Summary of maintenance performed this reporting period: Munster exercised gates, removed weeds, greased. LCRBDC mowed.		
5. Summary of maintenance planned next reporting period: Exercise and grease gates, remove weeds, mow.		
6. Summary of changes to segment / system since last inspection:		
7. Problems/ issues requiring the assistance of the US Army Corps of Engineers:		

General Instructions for the Inspection of Flood Damage Reduction Segments / Systems

A. Purpose of USACE Inspections

The primary purpose of these inspections is to prevent loss of life and catastrophic damages; preserve the value of Federal investments, and to encourage non-Federal sponsors to bear responsibility for their own protection. Inspections should assure that Flood Damage Reduction structures and facilities are continually maintained and operated as necessary to obtain the maximum benefits. Inspections are also conducted to determine eligibility for Rehabilitation Assistance under authority of PL 84-99 for Federal and non-Federal systems. (ER 1130-2-530, ER 500-1-1)

B. Types of Inspections:

The Corps conducts several types of inspections of Flood Damage Reduction systems, as outlined below:

Initial Eligibility Inspections	Continuing Eligibility Inspections	
	Routine Inspections	Periodic Inspections
IEIs are conducted to determine whether a non-Federally constructed Flood Damage Reduction system meets the minimum criteria and standards set forth by the Corps for initial inclusion into the Rehabilitation and Inspection Program.	RIIs are intended to verify proper maintenance, owner preparedness, and component operation.	PIIs are intended to verify proper maintenance and component operation and to evaluate operational adequacy, structural stability, and safety of the system. Periodic Inspections evaluate the system's original design criteria vs. current design criteria to determine potential performance impacts, evaluate the current conditions, and compare the design loads and design analysis used against current design standards. This is to be done to identify components and features for the sponsor that need to be monitored more closely over time or corrected as needed. (Periodic Inspections are used as the basis of risk assessments.)

C. Inspection Boundaries:

Inspections should be conducted so as to rate each Flood Damage Reduction "Segment" of the system. The overall system rating will be the lowest segment rating in the system.

Project	System	Segment
A flood damage reduction project is made up of one or more flood damage reduction systems which were under the same authorization.	A flood damage reduction system is made up of one or more flood damage reduction segments which collectively provide flood damage reduction to a defined area. Failure of one segment within a system constitutes failure of the entire system. Failure of one system does not affect another system.	A flood damage reduction segment is defined as a discrete portion of a flood damage reduction system that is operated and maintained by a single entity. A flood damage reduction segment can be made up of one or more features (levee, floodwall, pump stations, etc).

D. Land Use Definitions:

The following three definitions are intended for use in determining minimum required inspection intervals and initial requirements for inclusion into the Rehabilitation and Inspection Program. Inspections should be considered for all systems that would result in significant environmental or economic impact upon failure regardless of specific land use.

Agricultural	Rural	Urban
Protected population in the range of zero to 5 households per square mile protected.	Protected population in the range of 6 to 20 households per square mile protected.	Greater than 20 households per square mile; major industrial areas with significant infrastructure investment. Some protected urban areas have no permanent population but may be industrial areas with high value infrastructure with no overnight population.

E. **Use of the Inspection Report Template:**

The report template is intended for use in all Army Corps of Engineers inspections of levee and floodwall systems and flood damage reduction channels. The section of the template labeled \"Initial Eligibility\" only needs to be completed during Initial Eligibility Inspections of Non-Federally constructed Flood Damage Reduction Systems. The section labeled \"General Items\" needs to be completed with every inspection, along with all other sections that correspond to features in the system. The section labeled \"Public Sponsor Pre-Inspection Report\" is intended for completion before the inspection, if possible.

F. **Individual Item / Component Ratings:**

Assessment of individual components rated during the inspection should be based on the criteria provided in the inspection report template, though inspectors may incorporate additional items into the report based on the characteristics of the system. The assessment of individual components should be based on the following definitions.

Acceptable Item	Minimally Acceptable Item	Unacceptable Item
The inspected item is in satisfactory condition, with no deficiencies, and will function as intended during the next flood event.	The inspected item has one or more minor deficiencies that need to be corrected. The minor deficiency or deficiencies will not seriously impair the functioning of the item as intended during the next flood event.	The inspected item has one or more serious deficiencies that need to be corrected. The serious deficiency or deficiencies will seriously impair the functioning of the item as intended during the next flood event.

G. **Overall Segment / System Ratings:**

Determination of the overall system rating is based on the definitions below. Note that an Unacceptable System Rating may be either based on an engineering determination that concluded that noted deficiencies would prevent the system from functioning as intended during the next flood event, or based on the sponsor's demonstrated lack of commitment or inability to correct serious deficiencies in a timely manner.

Acceptable System	Minimally Acceptable System	Unacceptable System
All items or components are rated as Acceptable.	One or more items are rated as Minimally Acceptable or one or more items are rated as Unacceptable and an engineering determination concludes that the Unacceptable items would not prevent the segment / system from performing as intended during the next flood event.	One or more items are rated as Unacceptable and would prevent the segment / system from performing as intended, or a serious deficiency noted in past inspections (which had previously resulted in a minimally acceptable system rating) has not been corrected within the established timeframe, not to exceed two years.

H. **Eligibility for PL84-99 Rehabilitation Assistance:**

Inspected systems that are not operated and maintained by the Federal government may be Active in the Corps' Rehabilitation and Inspection Program (RIP) and eligible for rehabilitation assistance from the Corps as defined below:

If the Overall System Rating is Acceptable	If the Overall System Rating is Minimally Acceptable	If the Overall System Rating is Unacceptable
The system is active in the RIP and eligible for PL84-99 rehabilitation assistance.	The system is Active in the RIP during the time that it takes to make needed corrections. Active systems are eligible for rehabilitation assistance. However, if the sponsor does not present USACE with proof that serious deficiencies (which had previously resulted in a minimally acceptable system rating) were corrected within the established timeframe, then the system will become Inactive in the RIP.	The system is Inactive in the RIP, and the status will remain Inactive until the sponsor presents USACE with proof that all items rated Unacceptable have been corrected. Inactive systems are ineligible for rehabilitation assistance.

I. Reporting:

After the inspection, the Corps is responsible for assembling an inspection report (or a summary report if it was a Periodic Inspection) including the following information:

- a. All sections of the report template used during the inspection, including the cover and pre-inspection materials. (Supplemental data collected, and any sections of the template that weren't used during the inspection do not need to be included with the report.)
- b. Photos of the general system condition and noted deficiencies.
- c. A plan view drawing of the system, with stationing, to reference locations of items rated less than acceptable.
- d. The relative importance of the identified maintenance issues should be specified in the transmittal letter.
- e. If the Overall System Rating is Minimally Acceptable, the report needs to establish a timeframe for correction of serious deficiencies noted (not to exceed two years) and indicate that if these items are not corrected within the required timeframe, the system will be rated as Unacceptable and made Inactive in the Rehabilitation Inspection Program.

J. Notification:

Reports are to be disseminated as follows within 30 days of the inspection date.

If the Overall System Rating is Acceptable	If the Overall System Rating is Minimally Acceptable	If the Overall System Rating is Unacceptable
Reports need to be provided to the local sponsor and the county emergency management agency.	Reports need to be provided to the local sponsor, state emergency management agency, county emergency management agency, and to the FEMA region.	Reports need to be provided to the local sponsor, state emergency management agency, county emergency management agency, FEMA region, and to the Congressional delegation within 30 days of the inspection.

National Levee Database

NLD

For Official Use Only

LEVEE INSPECTION MAPBOOK

Levee Segment Munster

NLD Levee Segment ID
2604000009

Location
Munster

Inspection Type
Routine

Start Date
06-Jul-2020

End Date
06-Jul-2020

Inspected By
Jeremy Harris, Yuki Galisanao



US Army Corps
of Engineers

SHEET INDEX



Levee: Munster

WARNING: This document is FOR OFFICIAL USE ONLY (FOUO)
It contains information that may be exempt from public release under the
Freedom of Information Act (5 USC 552). It is to be controlled, stored,
handled, transmitted, distributed, and disposed of in accordance with
USACE policy relating to FOUO information and it is not to be released
to the public or other personnel who do not have a valid \"need to know\"
without prior written approval of an authorized USACE official.



MAP ELEMENTS

5 Standard Sheets

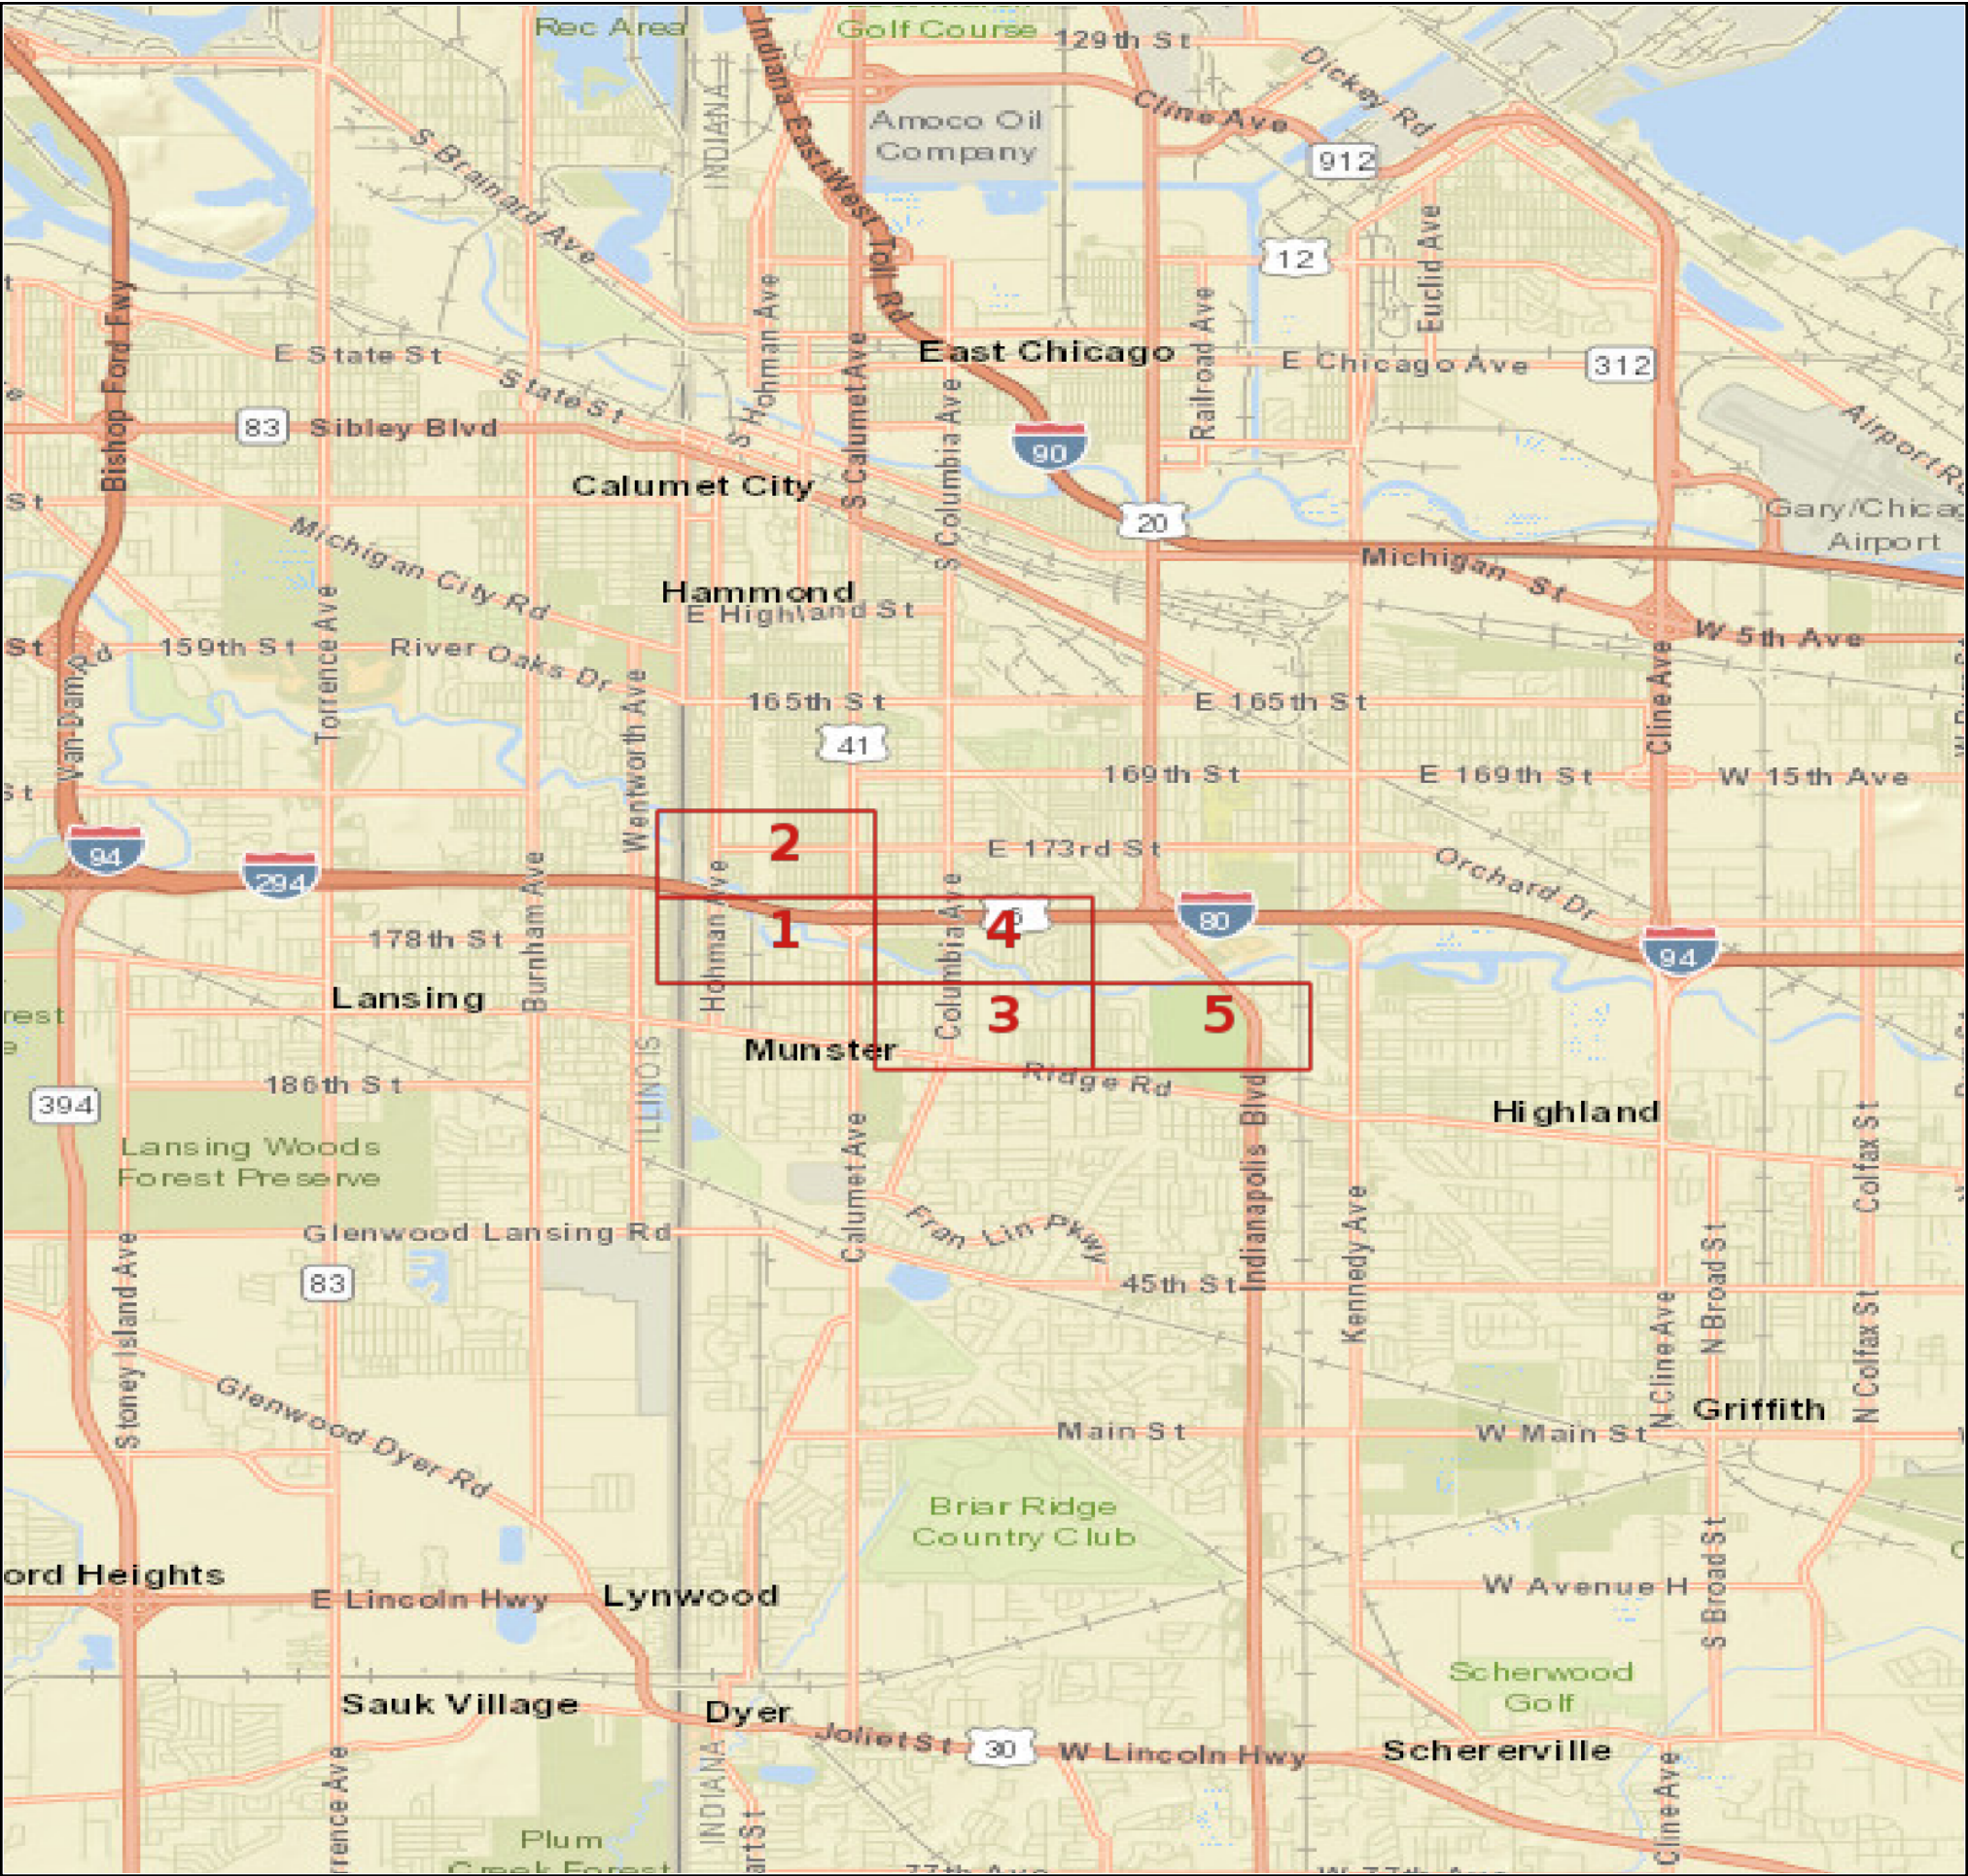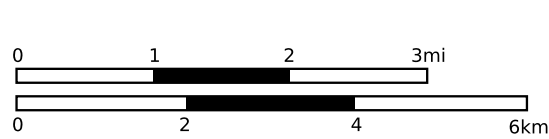



4


NONE



OBSERVATIONS

-  Acceptable
-  Minimally Acceptable
-  Unacceptable
-  Not Applicable

Scale = 1:6000



Sheet: 1

06-Jul-2020


Munster

Type: Routine

06-Jul-2020]

NLD

NONE

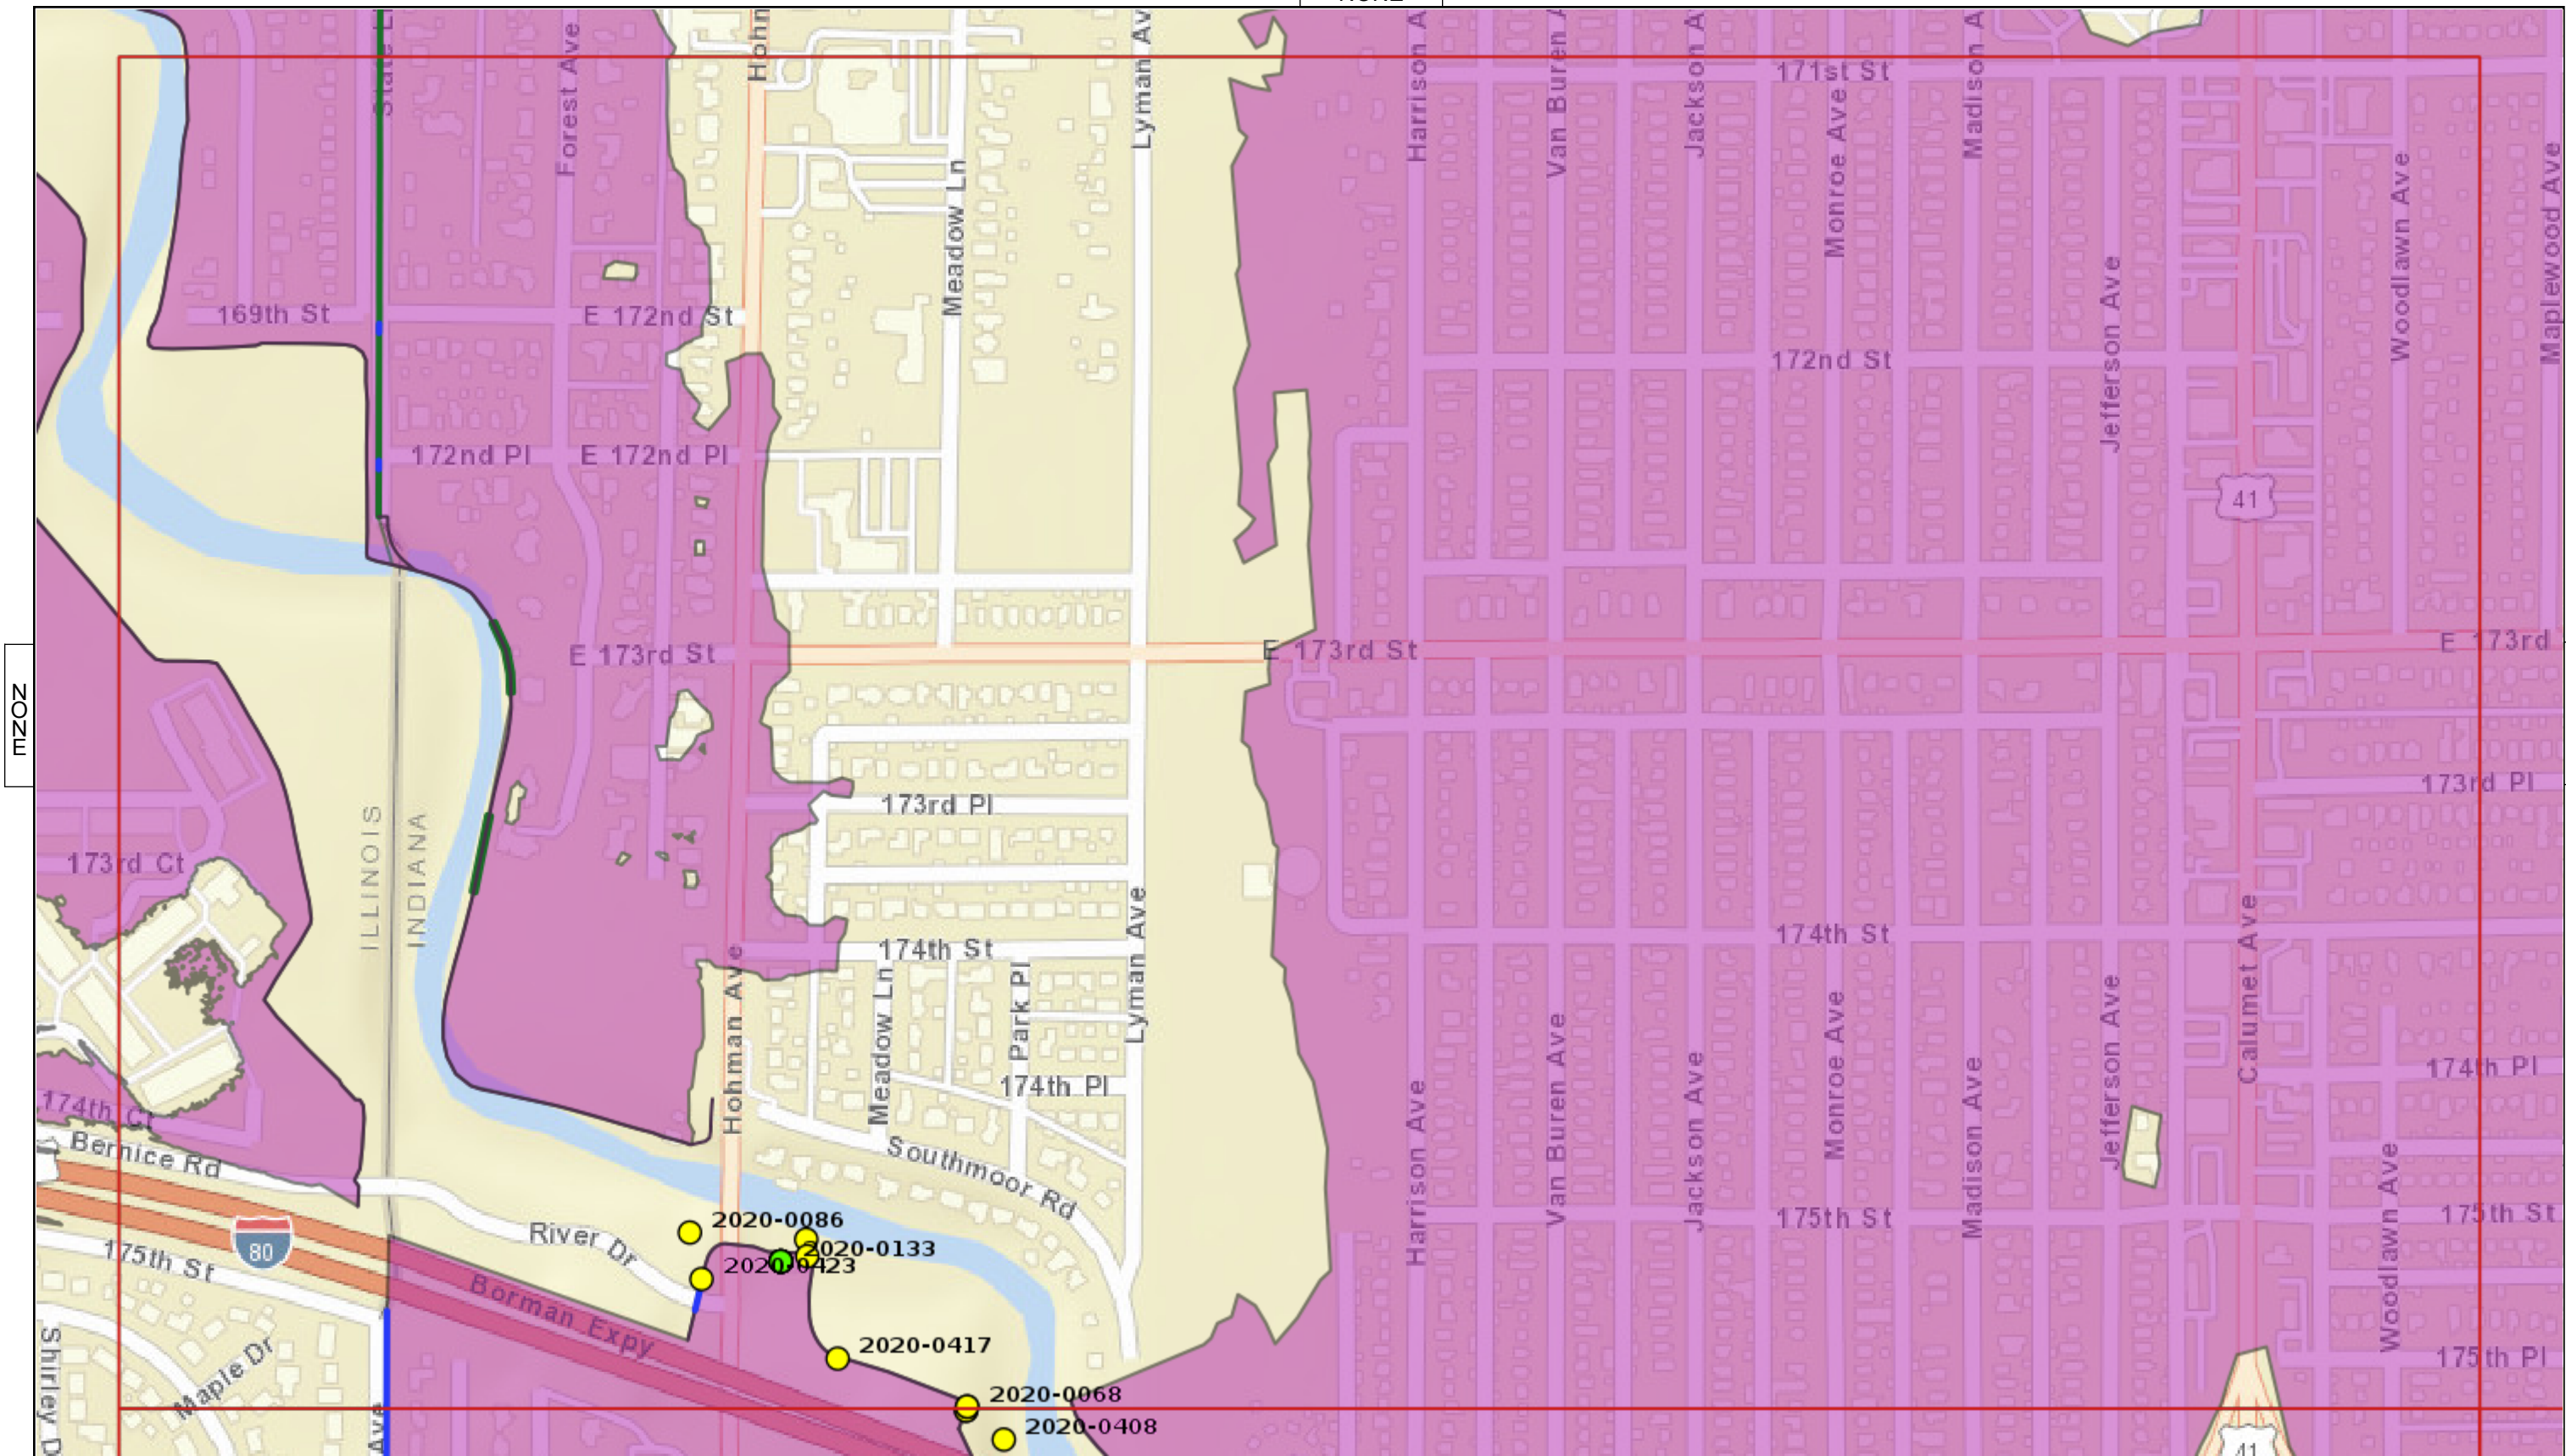

MZO

MZO



OBSERVATIONS

- Acceptable
- Minimally Acceptable
- Unacceptable
- Not Applicable

Scale = 1:6000



NLD


Sheet: 2

Munster

Type: Routine

06-Jul-2020

06-Jul-2020

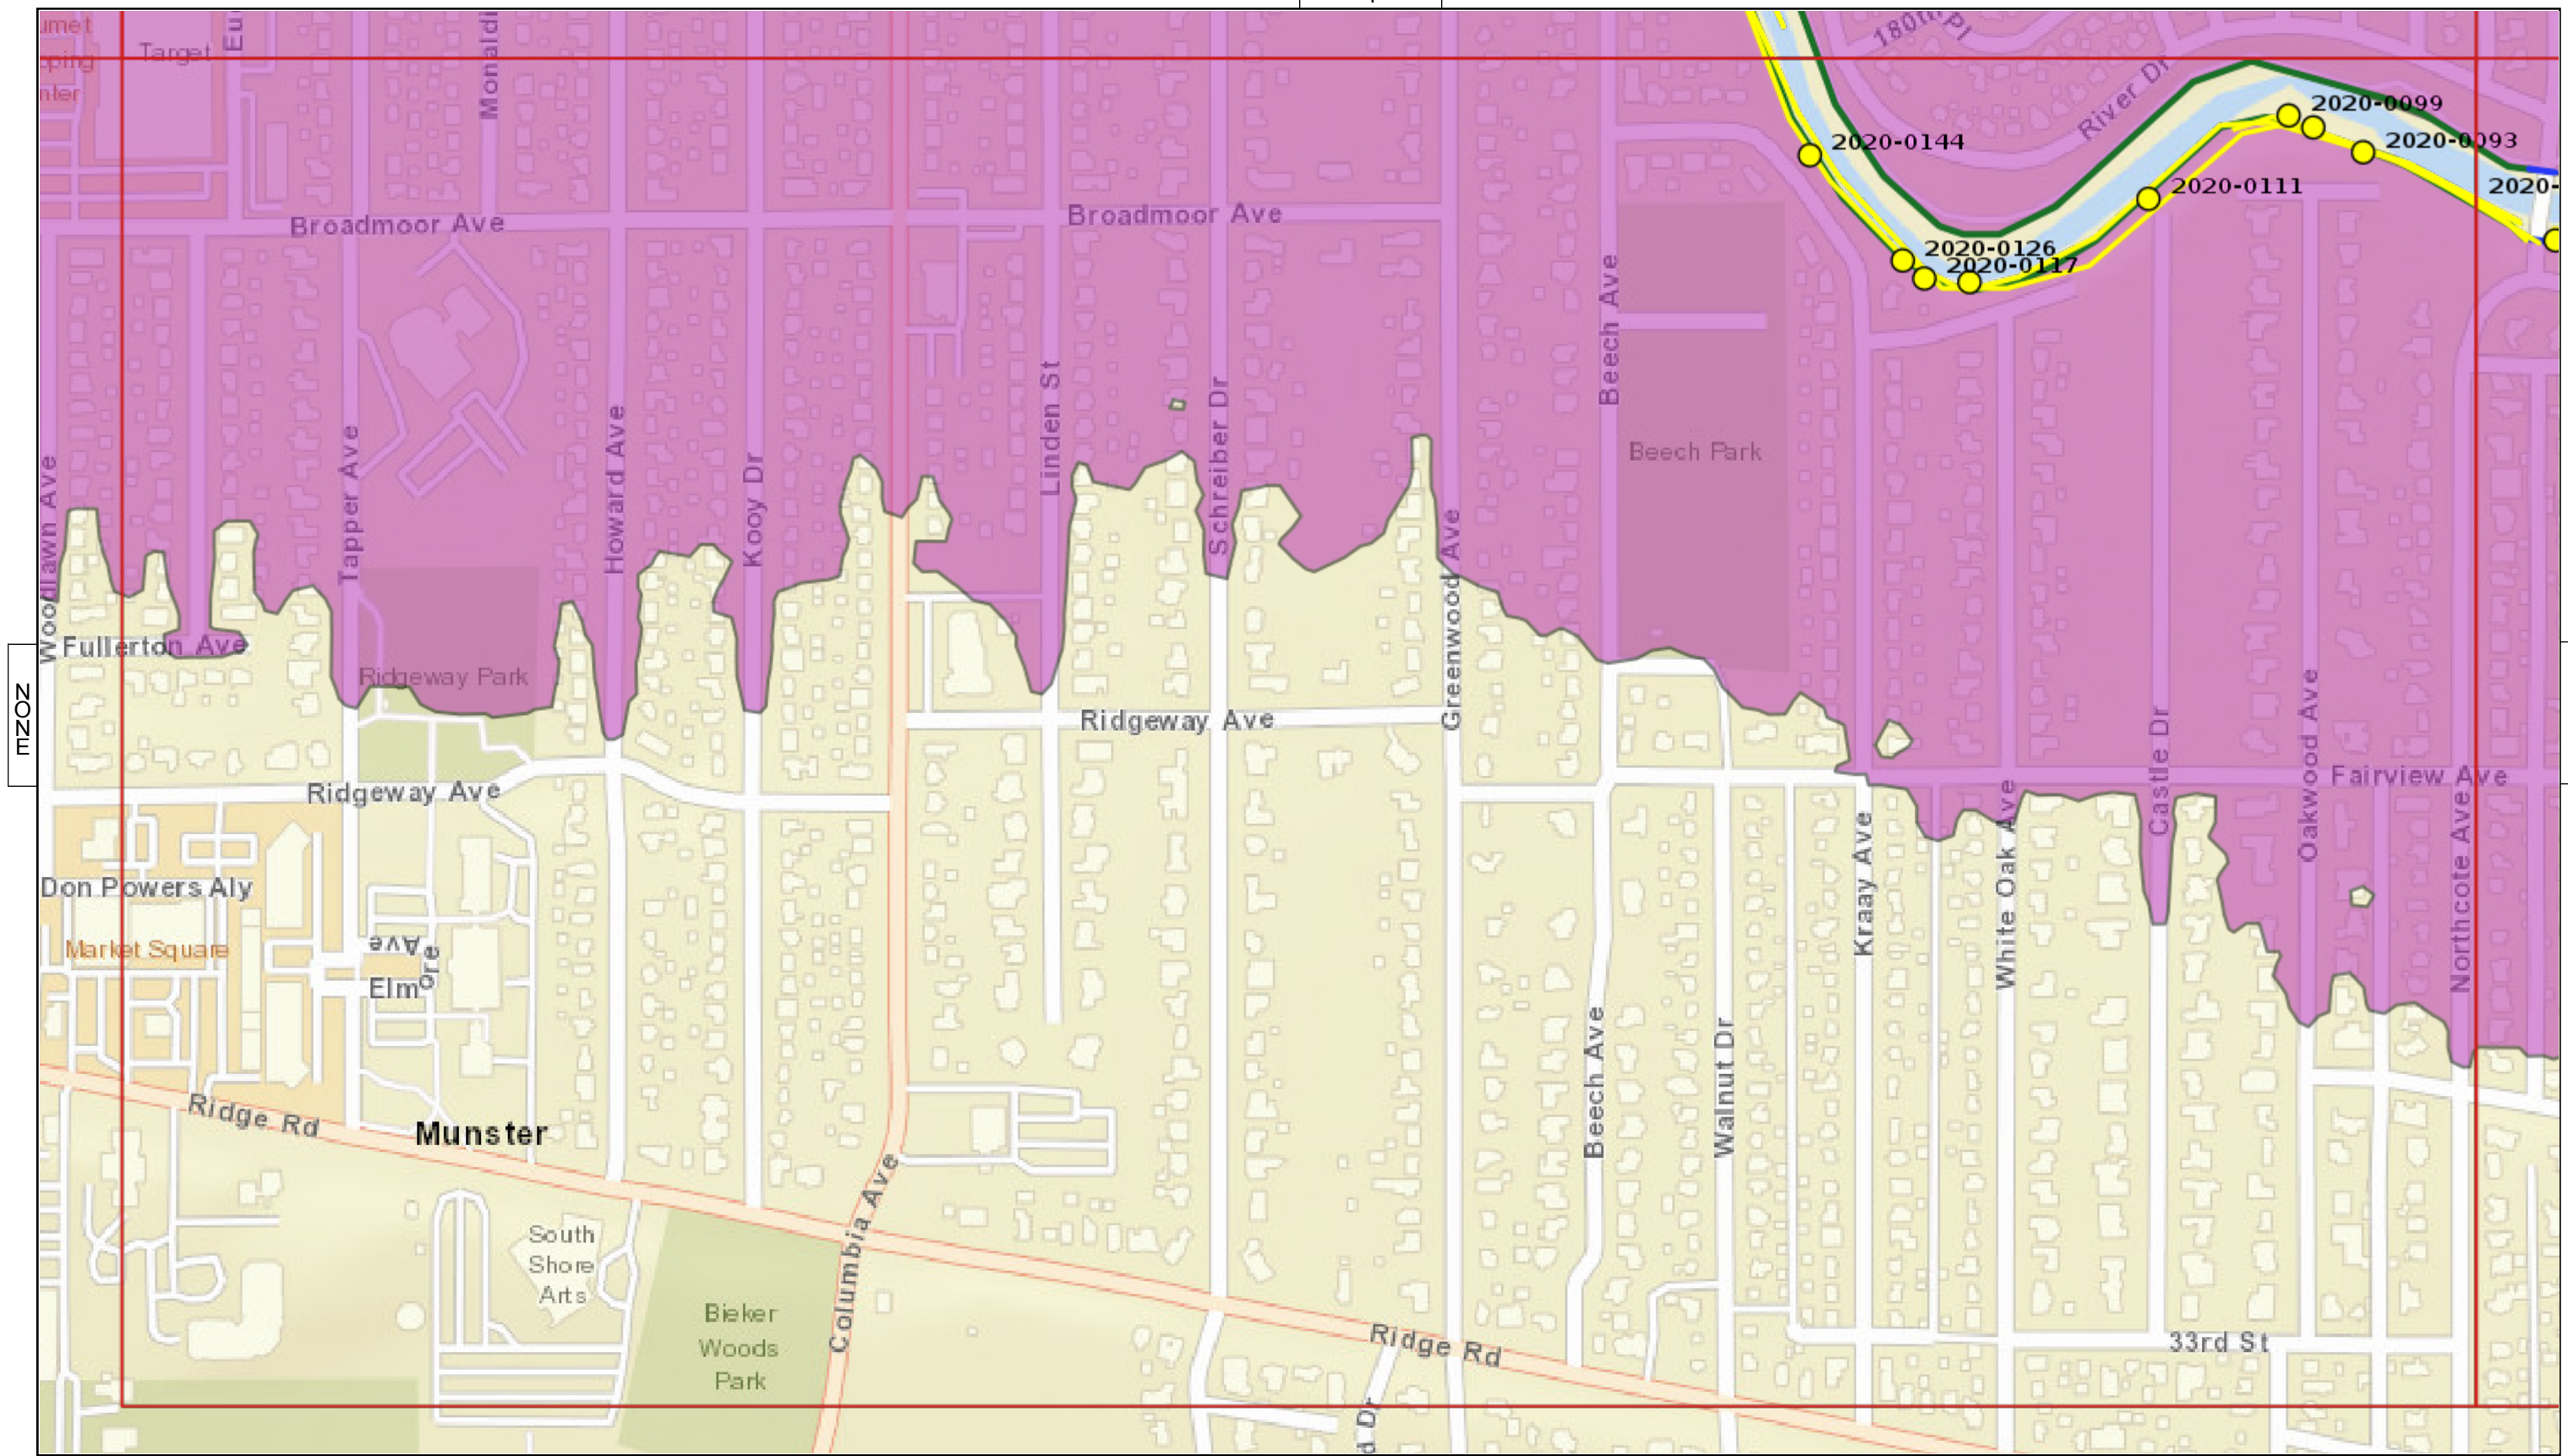

WZ02

5


NONE



OBSERVATIONS

-  Acceptable
-  Minimally Acceptable
-  Unacceptable
-  Not Applicable

Scale = 1:6000



NLD

Sheet: 3


Munster

Type: Routine

06-Jul-2020

06-Jul-2020

NONE

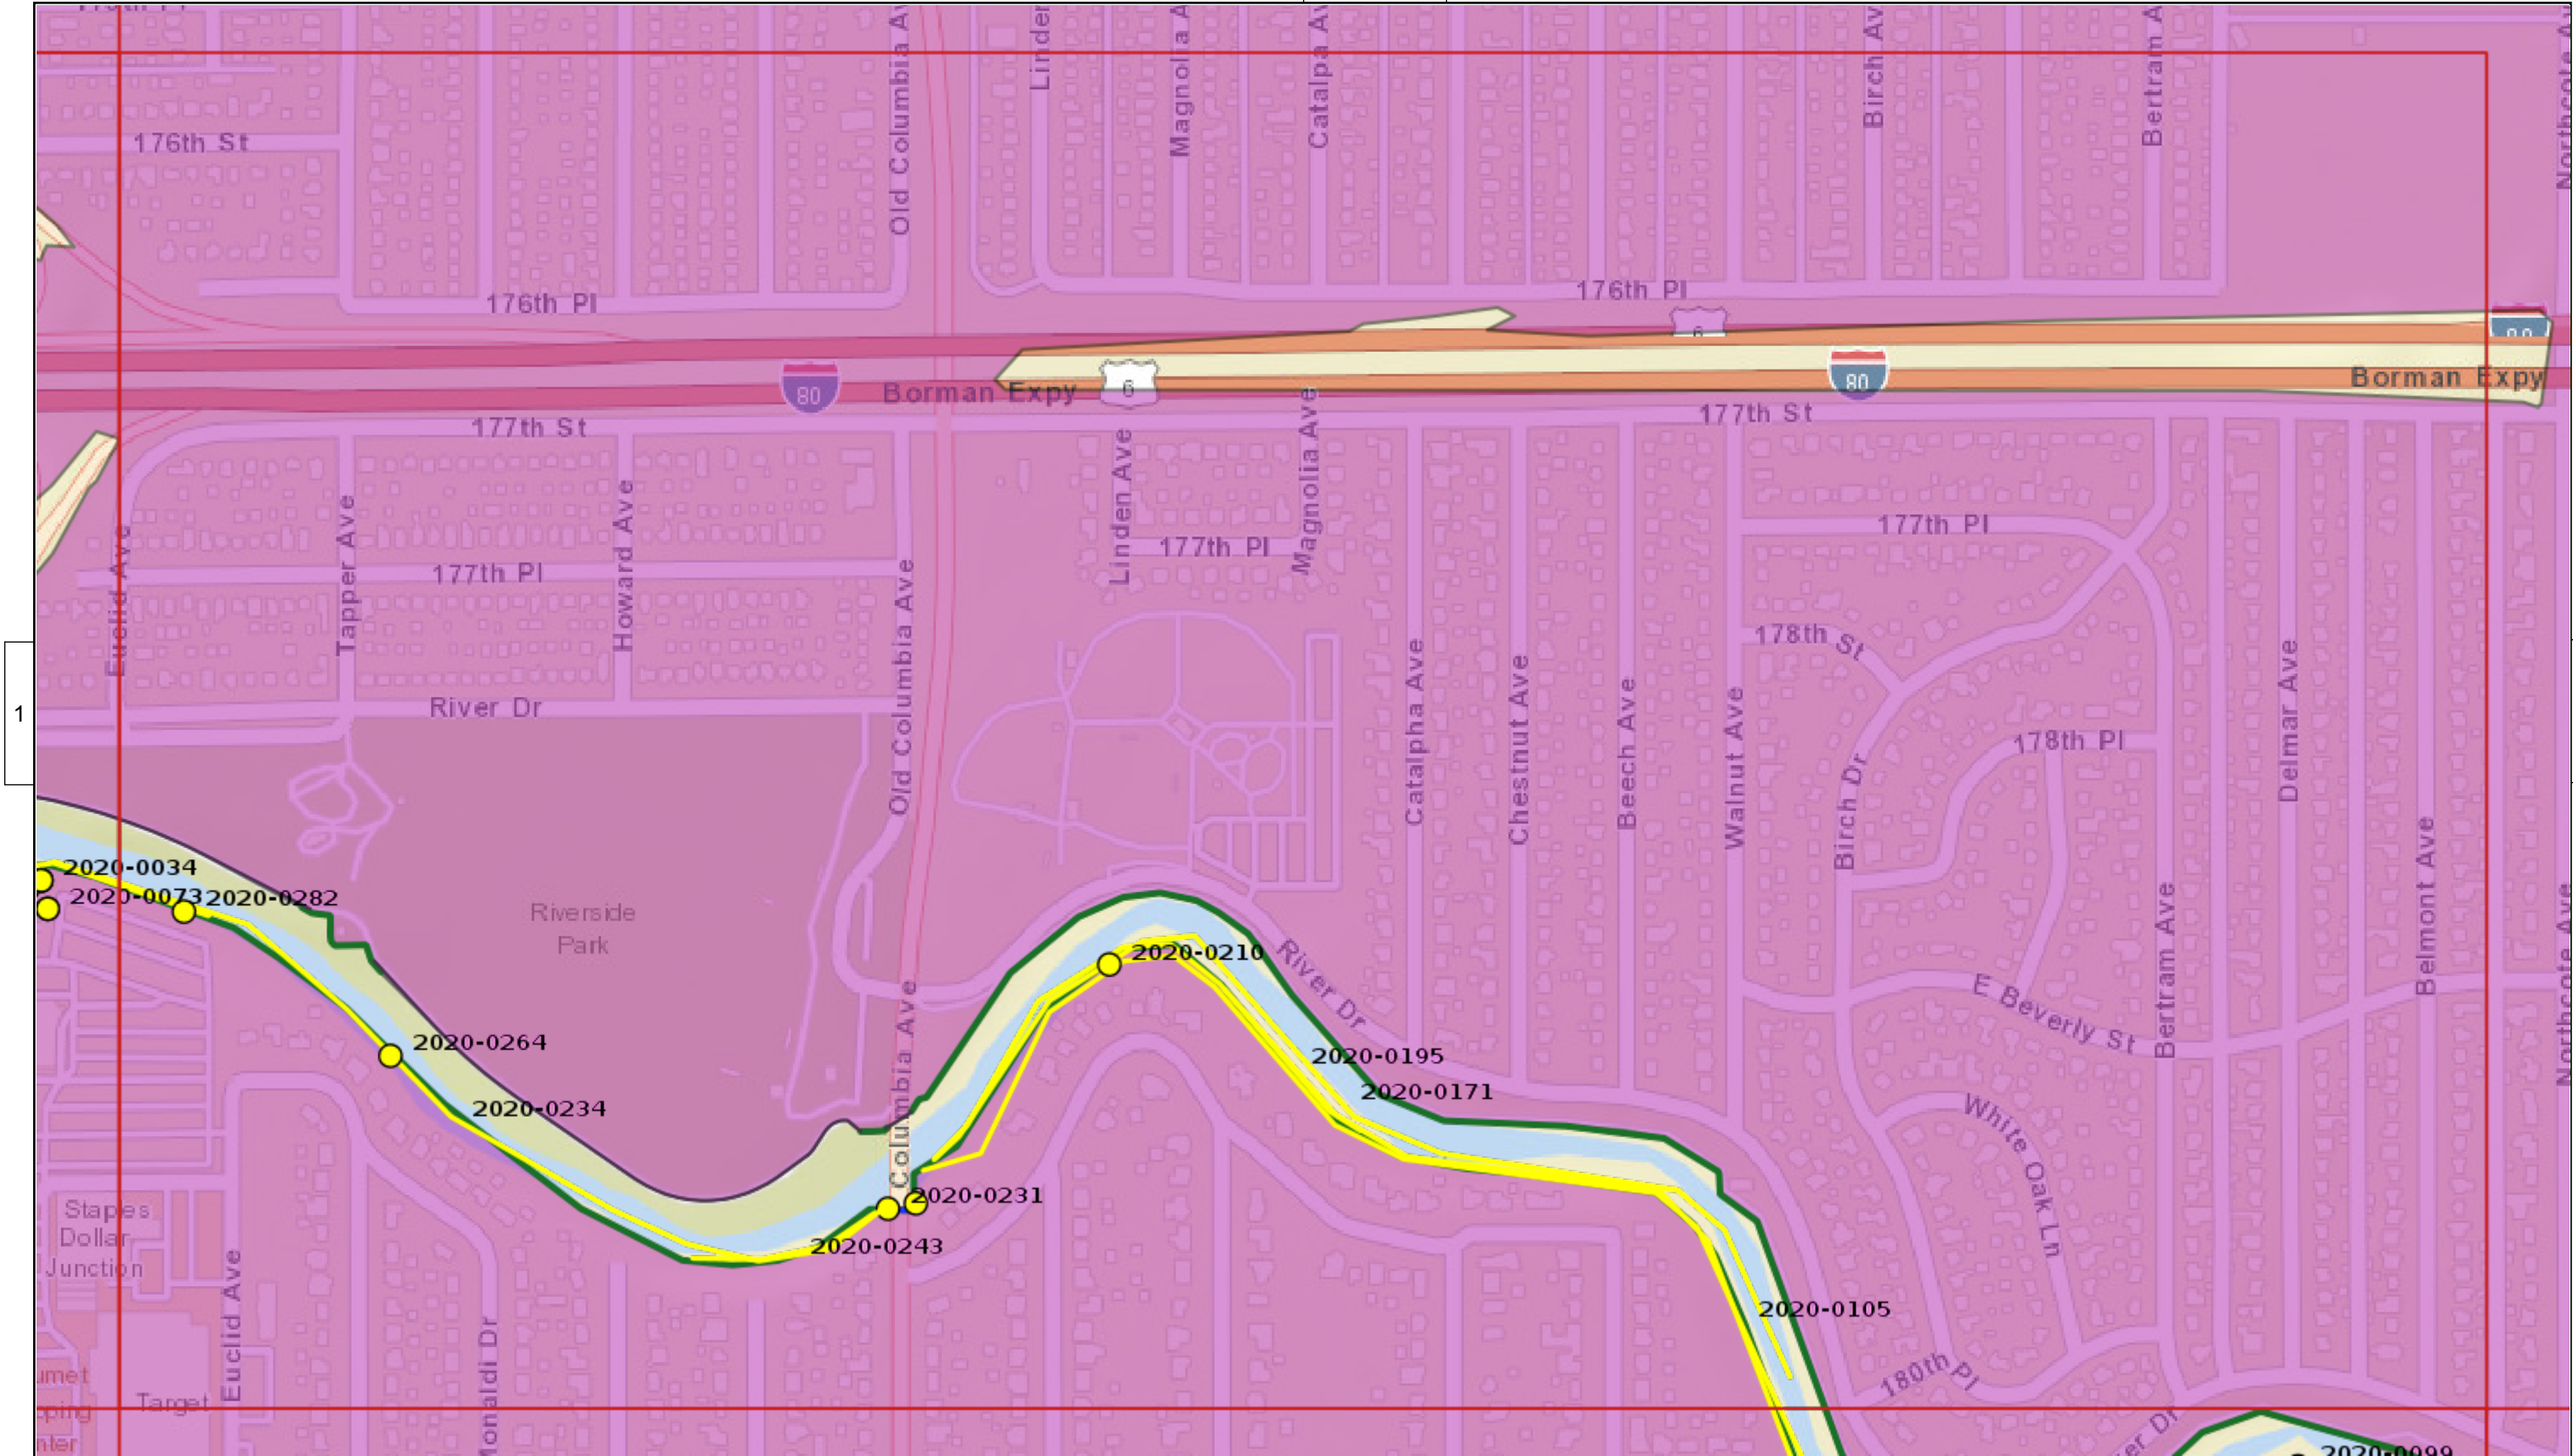

3



OBSERVATIONS


-  Acceptable
-  Minimally Acceptable
-  Unacceptable
-  Not Applicable

Scale = 1:6000



NLD	Sheet: 4	06-Jul-2020
	Munster	
	Type: Routine	06-Jul-2020

NONE

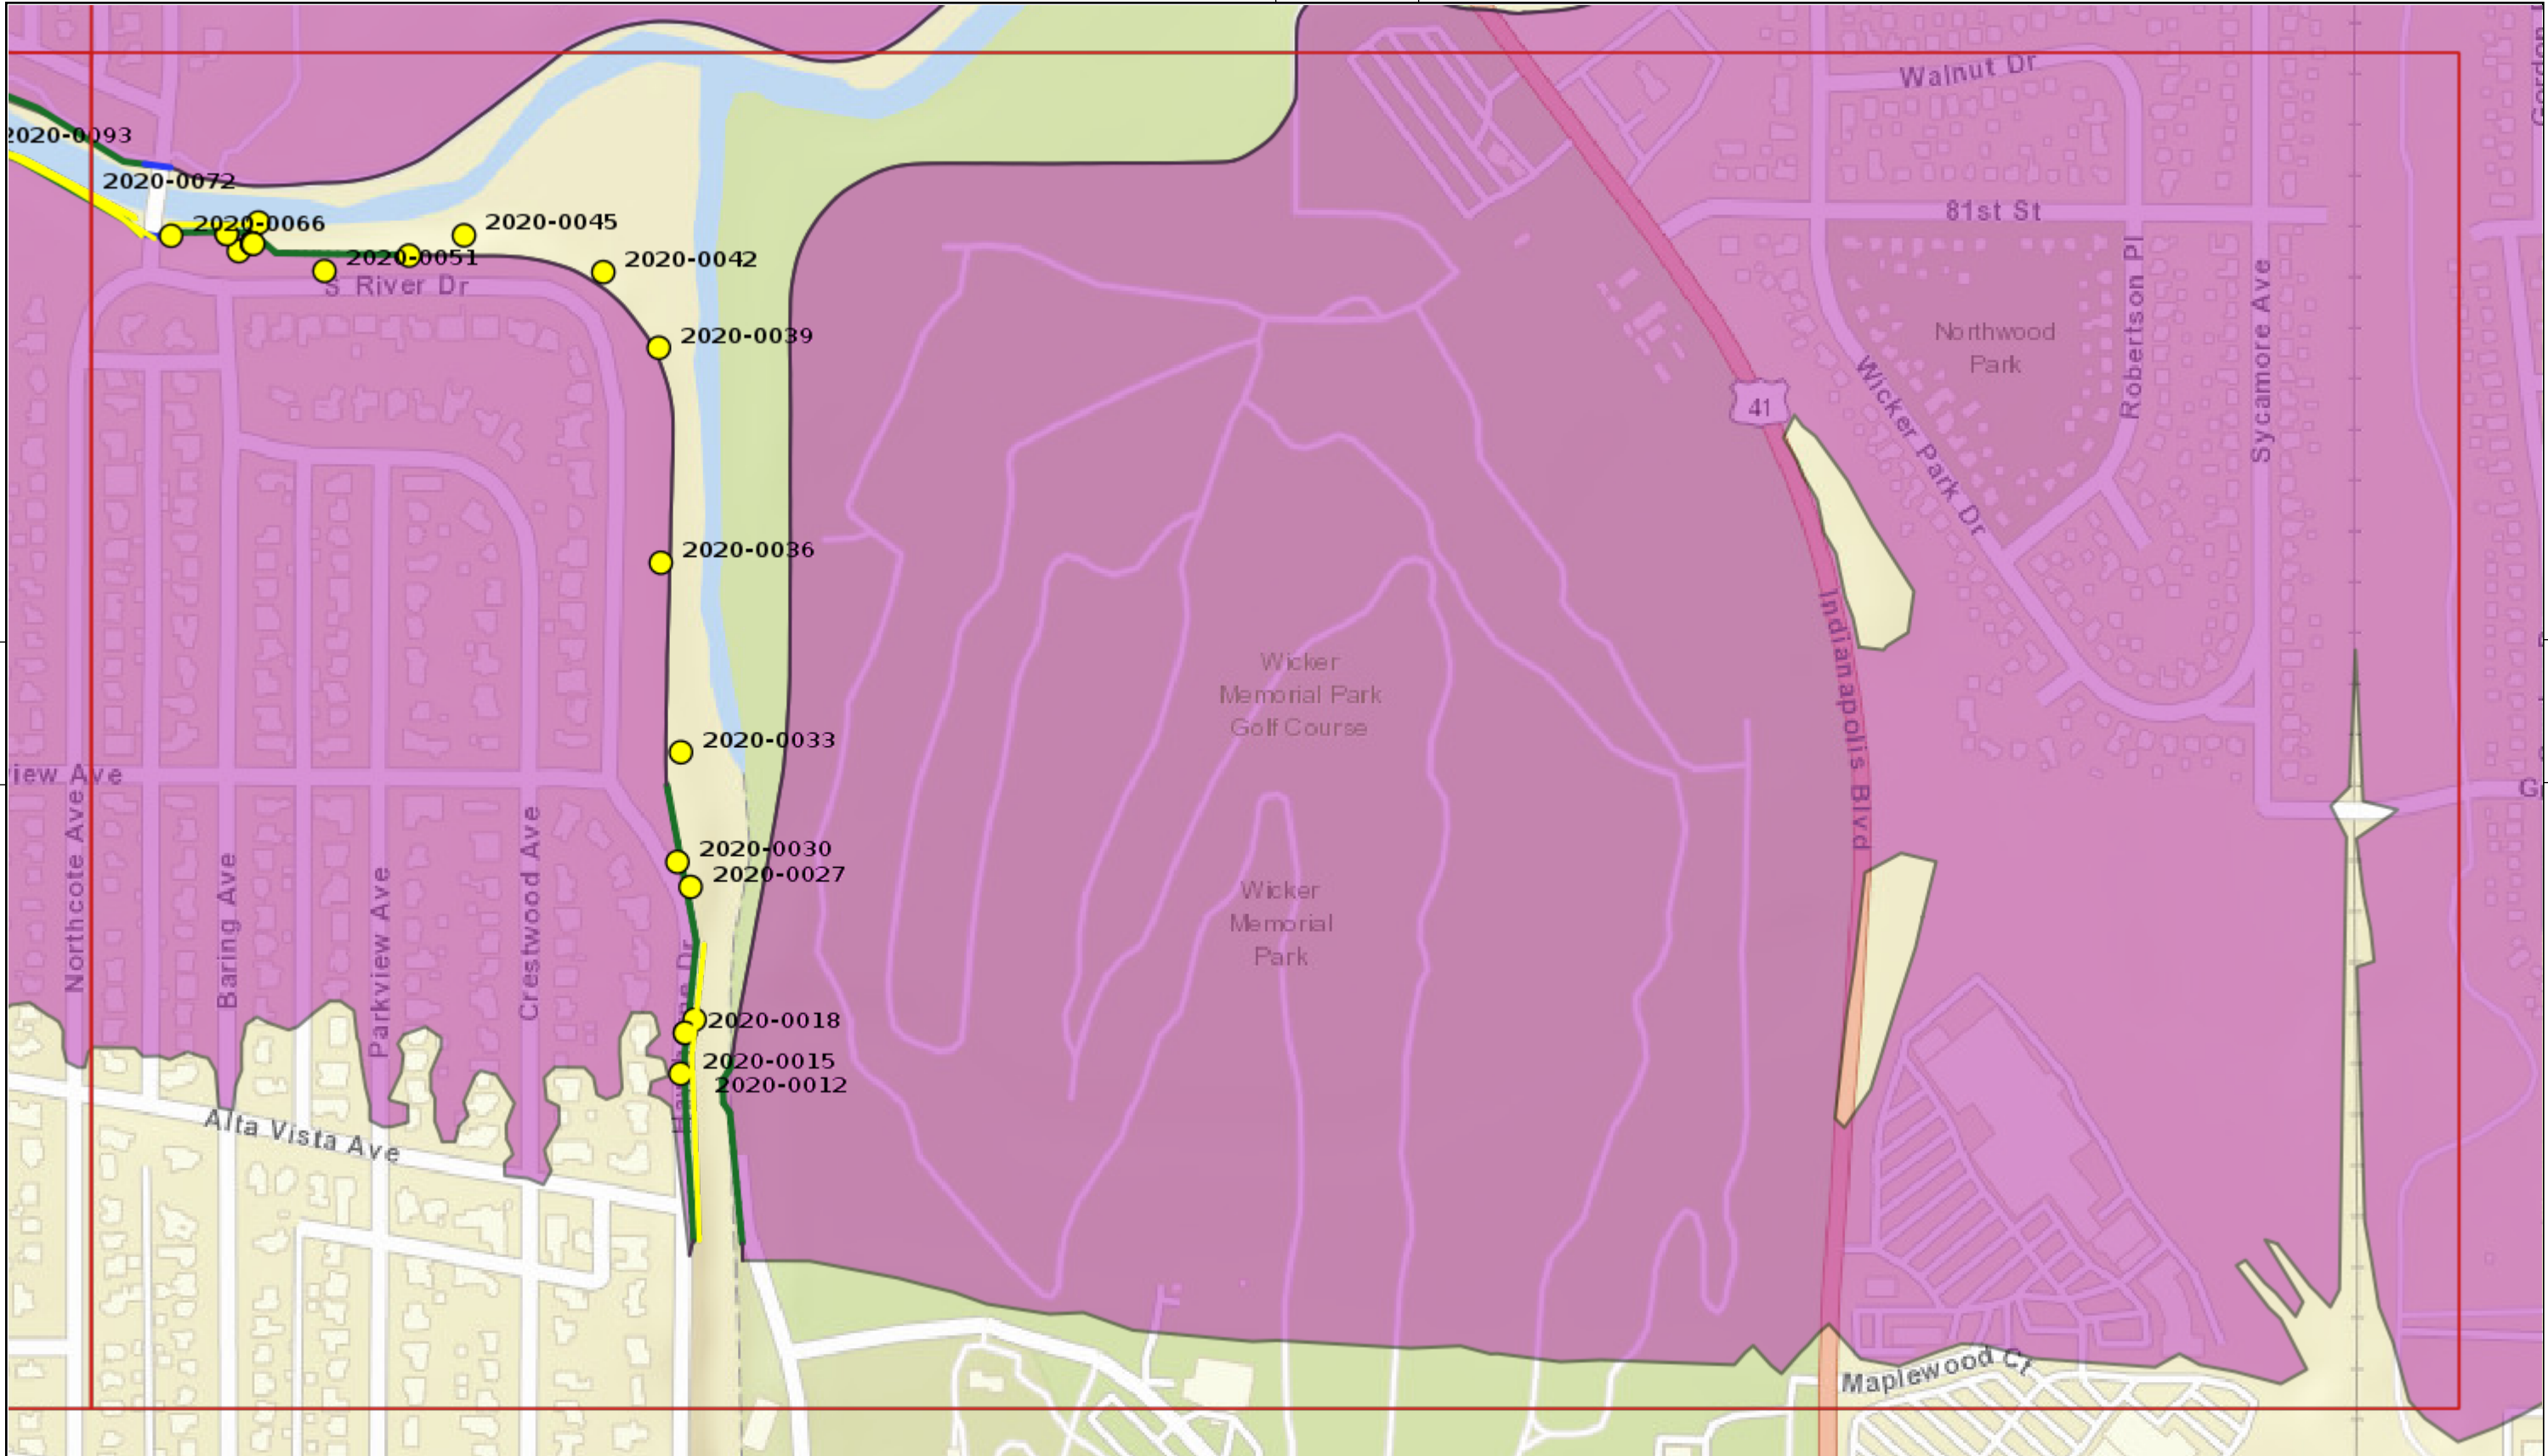

3

IN


NONE



OBSERVATIONS

-  Acceptable
-  Minimally Acceptable
-  Unacceptable
-  Not Applicable

Scale = 1:6000



NLD

Sheet: 5

06-Jul-2020

Munster

Type: Routine

06-Jul-2020

Rehabilitation Program Eligibility Determination

In order to be eligible, all of the following items must be rated A, M, N/A, or Yes.

Note: Item numbers listed below refer to their placement in the Inspection Checklist.

Name of Segment/System: Munster		
Public Sponsor(s): Little Calumet River Basin Development Commission		
Sponsor Representative: Dan Repay		
Sponsor Phone: 219-595-0599		
Sponsor Email: drepay@littlecalumetriverbasin.org		
Inspection Date: 7/6/20		
Rehabilitation Program Eligibility Determination		
Yes	<input checked="" type="checkbox"/>	Public sponsor provided maintenance information per the Public Sponsor Pre-Inspection Form.
No	<input type="checkbox"/>	
Yes	<input type="checkbox"/>	Non-federal levee system meets Initial Eligibility criteria.
No	<input type="checkbox"/>	
N/A	<input checked="" type="checkbox"/>	
If either of the above items is marked "No" the levee system is not eligible.		
Rating	Rated Item	
Levee Embankments		
A	<input type="checkbox"/>	3. Encroachments
M	<input checked="" type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	4. Closure structures (Stop Log, Earthen Closures, Gates, or Sandbag Closures)
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	5. Slope Stability
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	6. Erosion/ Bank Caving
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input type="checkbox"/>	10. Animal Control
M	<input checked="" type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	11. Culverts/Discharge Pipes (This item includes both concrete and corrugated metal pipes.)
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
A	<input type="checkbox"/>	14. Underseepage Relief Wells/Toe Drainage Systems
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input checked="" type="checkbox"/>	

Floodwalls		
A	<input type="checkbox"/>	2. Encroachments
M	<input checked="" type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	3. Closure Structures (Stop Log Closures and Gates)
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	5. Tilting, Sliding, or Settlement of Concrete Structures
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input type="checkbox"/>	6. Foundation of Concrete Structures
M	<input checked="" type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input type="checkbox"/>	8. Underseepage Relief Wells/Toe Drainage Systems
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input checked="" type="checkbox"/>	
Interior Drainage Systems		
A	<input checked="" type="checkbox"/>	9. Culvert/Discharge Pipes
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
A	<input type="checkbox"/>	10. Sluice/Slide Gates
M	<input checked="" type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
A	<input type="checkbox"/>	11. Flap gates/Flap Valves/Pinch Valves
M	<input checked="" type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
Pump Stations		
A	<input checked="" type="checkbox"/>	17. Intake and Discharge Pipelines
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	18. Sluice/Slide Gates
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	
A	<input checked="" type="checkbox"/>	19. Flap Gates/Flap Valves/Pinch Valves
M	<input type="checkbox"/>	
U	<input type="checkbox"/>	
N/A	<input type="checkbox"/>	

